



WATER POWER ACT & ENVIRONMENT ACT LICENCES 2023 ANNUAL WATER LEVEL COMPLIANCE REPORT FOR WUSKWATIM GENERATING STATION

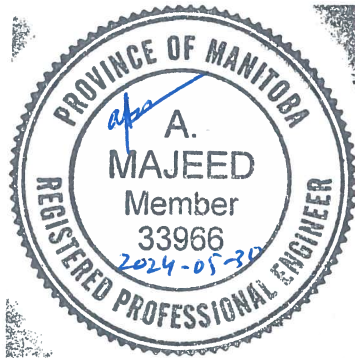

IMPORTANT

THIS MATERIAL IS THE EXCLUSIVE PROPERTY
OF MANITOBA HYDRO AND ALL RIGHTS ARE
RESERVED. ANY RELEASE, REPRODUCTION OR
OTHER USE THEREOF, WITHOUT THE EXPRESS
WRITTEN CONSENT OF MANITOBA HYDRO, IS
STRICTLY PROHIBITED.

PREPARED BY:


A. MAJEED

REVIEWED BY:


B.W. GIESBRECHT

APPROVED BY:



W.V. PENNER

DATE:

2024-05-30

DISTRIBUTION:

A. WITTMAN (MANITOBA ENVIRONMENT AND CLIMATE CHANGE)
T. SALER (GENERATION OPERATIONS & MAINTENANCE)
V. COLE (INDIGENOUS AND COMMUNITY RELATIONS)
CORPORATE LIBRARY

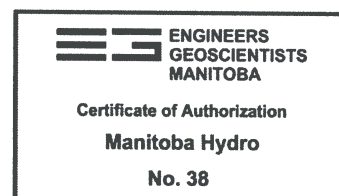

EXECUTIVE SUMMARY

Manitoba Hydro operates the Wuskwatim GS on behalf of Wuskwatim Power Limited Partnership in accordance with the Water Power Act and Environment Act licences issued by the Province of Manitoba. These licences constrain the water level on Wuskwatim Lake, and the rate of change in water level on Birch Tree Lake.

Environment Act Licence No. 2699 for Wuskwatim GS requires an annual water level report for each calendar year. This report addresses all water level constraints imposed by both the Water Power Act and Environment Act licences and contains information on data collection, validation, and reporting, as well as a summary of licence limit exceedances during the year.

There were eight Birch Tree Lake licence limit exceedances during 2023. Investigation into these events concluded that one of the Birch Tree Lake events was not attributable to Wuskwatim operations. The reasons for the occurrence of these events are explained in Sections 5.2, 5.3 and Appendix I. A summary of Wuskwatim compliance is provided below.

Location	Constraint	Variable	Exceedances Attributed to Wuskwatim Operations	Number of Readings	% Compliance
Wuskwatim Lake	Max/Min Elevation	Mean Daily Water Level	0	365	100 %
Wuskwatim Lake	Max/Min Elevation	Hourly Water Level	0	8760	100 %
Birch Tree Lake	Water Level Variation	Mean Daily Water Level	7	365	98.1%

Manitoba Hydro is in the process of refining operations to reduce the number of licence limit exceedances on Birch Tree Lake.

TABLE OF CONTENTS

1.0	INTRODUCTION.....	1
1.1	Background	1
1.2	Objective	1
1.3	Outline	1
2.0	WUSKWATIM GENERATING STATION.....	2
2.1	Project Location	2
2.2	Project Description	2
3.0	DATA COLLECTION	3
3.1	Water Level Gauges.....	3
3.2	Data Transmission and Storage	4
4.0	WATER POWER ACT AND ENVIRONMENT ACT DATA REPORTING	4
4.1	Monitoring & Reporting Process	4
4.2	Data Sources	4
4.3	Compliance.....	5
4.4	Compliance Reporting.....	5
5.0	SUMMARY OF FINDINGS	6
5.1	Data Analysis	6
5.2	Licence Exceedances	6
5.3	Licence Exceedances Explanation.....	7
6.0	MAJOR SYSTEM UPGRADES/CHANGES	8
7.0	DAM SAFETY	8
8.0	CONCLUSIONS & CLOSURE.....	8

APPENDICES

APPENDIX I	Correspondence with Manitoba Environment and Climate Change regarding licence limit exceedances
APPENDIX II	2023 Wuskwatim Dam Safety Activities List

1.0 INTRODUCTION

1.1 Background

Wuskwatim Power Limited Partnership (WPLP) is a legal entity involving Nisichawayasihk Cree Nation (NCN) and Manitoba Hydro, which developed and now owns the Wuskwatim Generating Station (GS). Manitoba Hydro operates the station as part of the Manitoba power grid on behalf of WPLP.

WPLP received licences under The Water Power Act and The Environment Act for the development of the Wuskwatim GS. The Interim Water Power Act licence stipulates a maximum and minimum allowable water level on Wuskwatim Lake. Environment Act Licence No. 2699 stipulates a maximum and minimum water level on Wuskwatim Lake, a maximum daily change in water level on Birch Tree Lake, as well as monthly and annual reporting requirements. This report fulfills the annual reporting requirement of Environment Act Licence No. 2699.

Manitoba Hydro prepared the Wuskwatim GS Licence Implementation Guide for Water Levels to establish and document the water regime terms specified by the Wuskwatim licences. The guide was reviewed and approved by the Province of Manitoba and is available at:

https://www.gov.mb.ca/sd/pubs/water/licensing/licence_implementation_guide_water_levels_2016.PDF

The Licence Implementation Guide forms the basis for the content of this report and provides the following details:

- calculation methodology to be used for determining critical levels,
- protocol for reporting to meet licence requirements, and
- manner in which compliance will be defined and assessed

1.2 Objective

This report documents Wuskwatim GS licence compliance by summarizing the Water Power Act and Environment Act licence requirements and providing the relevant water level data for the 2023 reporting period. In the case of any licence limit exceedance, this report provides the reason for the exceedance, actions taken to prevent such an event from occurring in the future, and proof of regulator notification.

1.3 Outline

Section 1.0 contains the introduction to the report, including background information on licence and reporting requirements, objective and outline of the report. Following the introduction is section 2.0, which provides the Wuskwatim GS project location and description. Section 3.0 summarizes the water level data collection process including data

transfer, storage and validation. Section 4.0 includes information about data sources, definition of compliance, and compliance reporting. Section 5.0 describes the data analysis used to prepare this report, includes a summary of deviations from licence constraints during the 2023 calendar year, and provides reasons for any licence deviations. Section 6.0 summarizes major system upgrades or changes during the 2023 calendar year, and Section 7.0 summarizes 2023 dam safety activities. Finally, Section 8.0 provides conclusions and closure to the report.

Appendix II provides a list of dam safety activities completed in 2023.

2.0 WUSKWATIM GENERATING STATION

2.1 Project Location

The Wuskwatim Generating Station is located on the Burntwood River, in the Nelson House Resource Management Area, approximately 56 km southwest of Thompson, 35 km southeast of Nelson House, or approximately 830 km north by road from Winnipeg. The geographical location of the station is shown in Figure 1. A photograph of the station is shown in Figure 2. A general arrangement of the site is shown in Figure 3.

2.2 Project Description

The Wuskwatim Generating Station consists of a 3-unit powerhouse with a nameplate capacity of 209 MW, gravity dams and embankment structures, and a 3-bay spillway with heated gates. Tables 1 and 2 summarize the operating parameters and construction specifications of the Wuskwatim Generating Station.

Table 1: Construction Specifications and Operating Parameters of the Wuskwatim Generating Station

Construction Period	2006 to 2012
Licensed Capacity	210 MW
2023 Generation	1,433 million kW-h
Waterfall Drop (head)	21.4 m
Maximum Licence Forebay Elevation	234.0 m
Minimum Licence Forebay Elevation	233.75 m

Table 2: Principal Structures for the Wuskwatim Generating Station

Powerhouse	Number of Units	3
	Length	75 m
	Discharge Capacity (at full gate)	1,100 m ³ /s
	Power Production	3 units @ 69.7 MW/unit TOTAL = 209 MW
Spillway	Number of Bays	3
	Total Length	43.0 m
	Discharge Capacity (Wuskwatim L. @ 234.0 m)	2,310 m ³ /s
Dams	Material	Impervious fill and granular fill
	Crest Elevation	236.69 – 237.08 m

The reservoir at Wuskwatim Generating Station has a total area of 88.41 km² and a fetch length of approximately 1.88 km. There is typically a 0.1 m drop between the reservoir level on Wuskwatim Lake and the forebay level of the station. The reservoir normal maximum water level is 234.0 m while the forebay normal maximum water level is 233.9 m. The incremental flooded area due to the project is 0.37 sq. km allowing the majority of the reservoir and forebay to be contained by natural river banks and minimizing the need for dykes.

Inflow to Wuskwatim is largely dependent on the Churchill River Diversion, as controlled by the Notigi Control Structure. The generating station operates in a daily cycling mode within the allowed 0.25 m water level range on Wuskwatim Lake.

The operators and maintenance personnel of the Wuskwatim Generating Station are located on site. Support and technical services are located in the nearby city of Thompson.

3.0 DATA COLLECTION

3.1 Water Level Gauges

Waterway Approvals and Monitoring staff compiled data from three remote water level gauges located on Wuskwatim Lake, and two remote water level gauges located on Birch Tree Lake to evaluate licence compliance for the 2023 reporting period. The locations of the water level gauges as well as the gauge description sheets are contained in Appendix A of the Licence Implementation Guide which is available at:

https://www.gov.mb.ca/sd/pubs/water/licensing/licence_implementation_guide_later_versions_2016.PDF

Manitoba Hydro uses the recorded water level data to measure compliance with the licence conditions as they apply to hourly and mean daily water levels (with wind and wave

effects eliminated) on Wuskwatim Lake, and daily average water level changes on Birch Tree Lake.

3.2 Data Transmission and Storage

Manitoba Hydro remote gauges on Wuskwatim and Birch Tree lakes use pressure transducers to record water levels and data loggers with transmitters to store and send this information through GOES satellites to ground based receivers both of which are operated by the National Oceanic and Atmospheric Administration (NOAA). Manitoba Hydro then retrieves the data via satellite rebroadcast from NOAA (with backup data sources being via internet data sources offered by NOAA and United States Geological Survey) as well as directly from the loggers during a site visit. Manitoba Hydro uses software applications that retrieve, decode and send the data to the HyDams database that is accessible to interested parties within Manitoba Hydro.

Water level data is collected and published according to the procedures and Quality Control Assurance processes established by Water Survey of Canada. Near real-time data is available but it is not recognized as official. Final data, or published data is generated through several levels of reviews to verify compliance with applicable standards and includes recognition of the impact of other related environmental and contextual factors.

Figure 4 shows the data transmission and storage process for remote gauge water level data used in the preparation of this report.

4.0 WATER POWER ACT AND ENVIRONMENT ACT DATA REPORTING

4.1 Monitoring & Reporting Process

As required by Clause 33 of Environment Act Licence No. 2699, an annual water level report for each calendar year, must be provided to Manitoba Environment and Climate Change. This report uses final data from the required water level gauges based on three levels of internal review. It also contains any compliance reports issued in the 2023 reporting period. Due to the quality assurance processing time, this report is issued by June 1 of the following year.

4.2 Data Sources

The water level data used in preparing this report was obtained from the Manitoba Hydro hydrometric database which contains water level data of various time steps including near real-time (5-minute interval), hourly, daily average and mean daily (with wind and wave effects eliminated) data. Hourly water level and flow data from Wuskwatim can be used in determining the operational impact of the project on Birch Tree Lake in case the Birch Tree Lake daily change in water level exceeds the licence limit.

4.3 Compliance

Section 4.2 of the Wuskwatim Interim Water Power Act licence states that:

The Licensee shall not raise the headwaters of its development above an elevation of 234.0 metres ASL as measured on Wuskwatim Lake, except as ordered by the Minister under Clause 72(b) of the Water Power Regulation or as fixed by the Minister under Clause 72(c) of the Water Power Regulation.

Clause 30(a) of Environment Act Licence No. 2699 states that the Licensee shall operate the Development within the following parameters:

Maintain the mean daily water level on Wuskwatim Lake (wind and wave effects eliminated) between 233.75 meters and 234.0 meters Above Sea Level (ASL), as determined by measurements from a minimum of three water level monitoring stations on Wuskwatim Lake.

Clause 30(b) of Environment Act Licence No. 2699 states that the Licensee shall operate the Development within the following parameters:

Maintain mean daily water levels on Birch Tree Lake such that the daily water level variations shall be less than 0.10 meters and 0.15 meters in open water and winter conditions (wind and wave effects eliminated) respectively. Any exceptions to these fluctuations shall be reported within one week to Manitoba Sustainable Development.

4.4 Compliance Reporting

Compliance for Wuskwatim GS has been defined and agreed upon with Manitoba Environment and Climate Change using the maximum and minimum water level limits stated by the Water Power Act and Environment Act licences. More precisely the Wuskwatim Lake water level shall be in compliance with the upper limit defined by both licences if:

1. The Wuskwatim Mean Daily Water Level (with wind and wave effects eliminated) does not exceed 234.0 metres, and
2. The Wuskwatim Hourly Water Level does not exceed 234.1 metres more than two times for two consecutive hours each time in any 24 hour period.

Furthermore, the Wuskwatim Lake water level is in compliance with the lower limit defined by both licences if:

1. The Wuskwatim Mean Daily Water Level (with wind and wave effects eliminated) does not recede below 233.75 metres, and
2. The Wuskwatim Hourly Water Level does not recede below 233.65 metres more than two times for two consecutive hours each time in any 24 hour period.

For the purpose of licence compliance at Birch Tree Lake, open water will refer to the period from May 1 to October 31 and winter will refer to the period from November 1 to April 30. The Birch Tree Lake Daily Change in water level is in compliance when:

1. The Birch Tree Lake Daily Change is below these seasonal limits, or
2. The Birch Tree Lake Daily Change is above these seasonal limits but the change attributable to Wuskwatim Generating Station is below these seasonal limits.

In the event that the Wuskwatim Lake or Birch Tree Lake water levels are not in compliance with the licence limits as described above, notification will be made to Manitoba Environment and Climate Change within one week of the incident. A follow up compliance report on causes contributing to the event and changes to operations, if any will also be provided.

WPLP publishes monthly and annual compliance reports on its web site at www.wuskwatim.ca.

5.0 SUMMARY OF FINDINGS

5.1 Data Analysis

Manitoba Hydro analyzed water level data to prepare charts outlining water conditions at Wuskwatim Lake and Birch Tree Lake during the 2023 reporting period. All readings were evaluated against licence limits to identify violations based on the definition of licence compliance given in Section 4.4.

Wuskwatim Lake Hourly Water Level, Wuskwatim Lake Mean Daily Water Level, and Birch Tree Lake Daily Water Level Change is shown in Figure 5, 6, and 7 respectively, for the 2023 reporting period.

5.2 Licence Exceedances

During the 2023 reporting period, there were eight recorded instances of water levels outside of the licence limits. The maximum number of possible instances was calculated as the sum of instances pertaining to each licence constraint and was based on the station operating from January 1 to December 31. Each licence constraint yields the following number of possible instances:

- Maximum/Minimum Mean Daily Water Level on Wuskwatim Lake – 365 days of possible instances,
- Maximum/Minimum Hourly Water Level on Wuskwatim Lake – $365 \text{ days} * 24 \text{ hours} = 8760$ possible instances, and
- Maximum Daily Water Level Change on Birch Tree Lake – 365 days

Table 3 shows a breakdown of licence limit exceedances for the 2023 reporting period. The Waterway Approvals and Monitoring Department investigated the incidents to determine the reason for the occurrence. Copies of correspondence notifying Manitoba Environment and Climate Change of the events are included in Appendix I of this report.

Table 3: Wuskwatim Generating Station, Water Power Act and Environment Act Licences: Summary of Events for the reporting period of 2023

Date	Location	Constraint	Variable
May 10, 2023*	Birch Tree Lake	Water Level Variation	Mean Daily Water Level
May 17, 2023	Birch Tree Lake	Water Level Variation	Mean Daily Water Level
Aug 10, 2023	Birch Tree Lake	Water Level Variation	Mean Daily Water Level
Sep 07, 2023	Birch Tree Lake	Water Level Variation	Mean Daily Water Level
Sep 08, 2023	Birch Tree Lake	Water Level Variation	Mean Daily Water Level
Sep 24, 2023	Birch Tree Lake	Water Level Variation	Mean Daily Water Level
Sep 29, 2023	Birch Tree Lake	Water Level Variation	Mean Daily Water Level
Oct 18, 2023	Birch Tree Lake	Water Level Variation	Mean Daily Water Level

**exceedance not attributable to Wuskwatim operation*

5.3 Licence Exceedances Explanation

The table below provides a brief explanation of the exceedance at Wuskwatim, which is further detailed in the correspondence included in Appendix I.

Table 4: Summary of Events and Explanation for the Reporting Period of 2023

Date	Location	Constraint	Explanation
May 10, 2023*	Birch Tree Lake	Water Level Variation	Increased outflow at Wuskwatim in response to the rapidly changing spring melt
May 17, 2023	Birch Tree Lake	Water Level Variation	A reduction in Wuskwatim outflow for water storage led to drop in the water level.
Aug 10, 2023	Birch Tree Lake	Water Level Variation	The transition from constant discharge operation to unit cycling operation, and back again due to decreased flow in Burntwood River caused water level to drop.
Sep 07, 2023	Birch Tree Lake	Water Level Variation	
Sep 08, 2023	Birch Tree Lake	Water Level Variation	
Sep 24, 2023	Birch Tree Lake	Water Level Variation	
Sep 29, 2023	Birch Tree Lake	Water Level Variation	
Oct 18, 2023	Birch Tree Lake	Water Level Variation	Starting the unit cycling operation earlier resulted in an increase in water level.

**exceedance not attributable to Wuskwatim operation*

Manitoba Hydro is refining operations to reduce license limit exceedances on Birch Tree Lake, resulting from required operational changes due to decreased Burntwood River flow. Manitoba Hydro continues to test a new operating procedure at Wuskwatim Generating Station, utilizing a rolling 24-hour average flow change, to prevent future occurrences of this type of exceedance.

6.0 MAJOR SYSTEM UPGRADES/CHANGES

Following maintenance and construction activities that occurred during the 2023 calendar year:

- Intake gate Gantry crane repairs

7.0 DAM SAFETY

Manitoba Hydro operates and maintains the generating station and associated structures at Wuskwatim based on the Canadian Dam Association Dam Safety Guidelines. A summary of dam safety activities for 2023 is provided in Appendix I.


8.0 CONCLUSIONS & CLOSURE

During the January 1 to December 31, 2023 reporting period, there were eight events where water levels deviated from the Water Power Act and Environment Act licence limits. Investigation into these events concluded that one of the Birch Tree Lake events was not attributable to Wuskwatim operations. Manitoba Hydro operated in compliance with the licences as shown in Table 3.

Table 5: Summary of 2023 Compliance

Location	Constraint	Variable	Exceedances Attributed to Wuskwatim Operations	Number of Readings	% Compliance
Wuskwatim Lake	Max/Min Elevation	Mean Daily Water Level	0	365	100 %
Wuskwatim Lake	Max/Min Elevation	Hourly Water Level	0	8760	100 %
Birch Tree Lake	Water Level Variation	Mean Daily Water Level	7	365	98.1 %

Manitoba Hydro continues to operate the Wuskwatim Generating Station in accordance with the Interim Licence under the Water Power Act for the development of water power at the Wuskwatim Site on the Burntwood River and Environment Act Licence No. 2699.

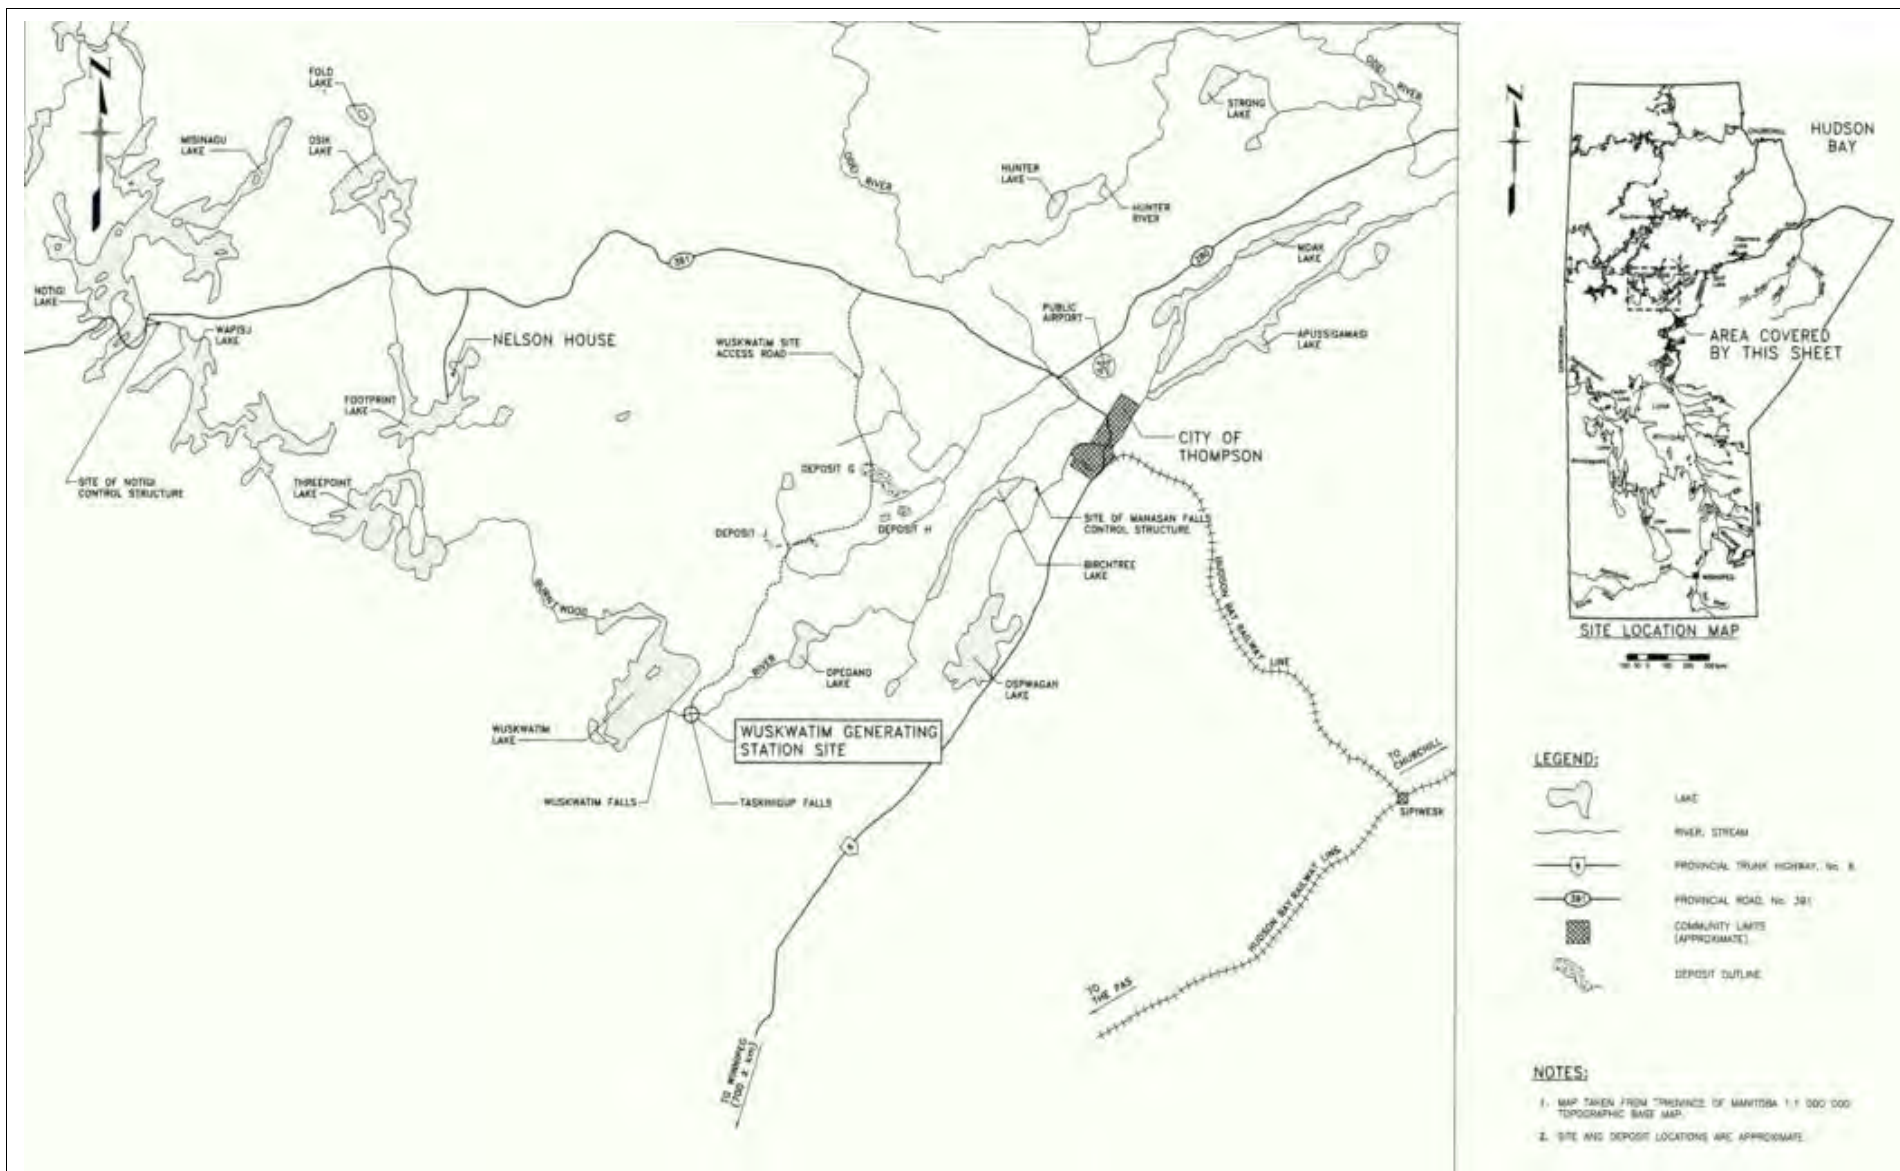

	MANITOBA HYDRO	
	WATERWAY APPROVALS AND MONITORING	
	WUSKWATIM GENERATING STATION	
	LOCATION MAP	
	PROJECT	
	ANNUAL WATER LEVEL REPORT	FIGURE 1



MANITOBA HYDRO

WATERWAY APPROVALS AND MONITORING


WUSKWATIM GENERATING STATION


PHOTOGRAPH OF GENERATING STATION

PROJECT

ANNUAL WATER LEVEL REPORT


FIGURE 2

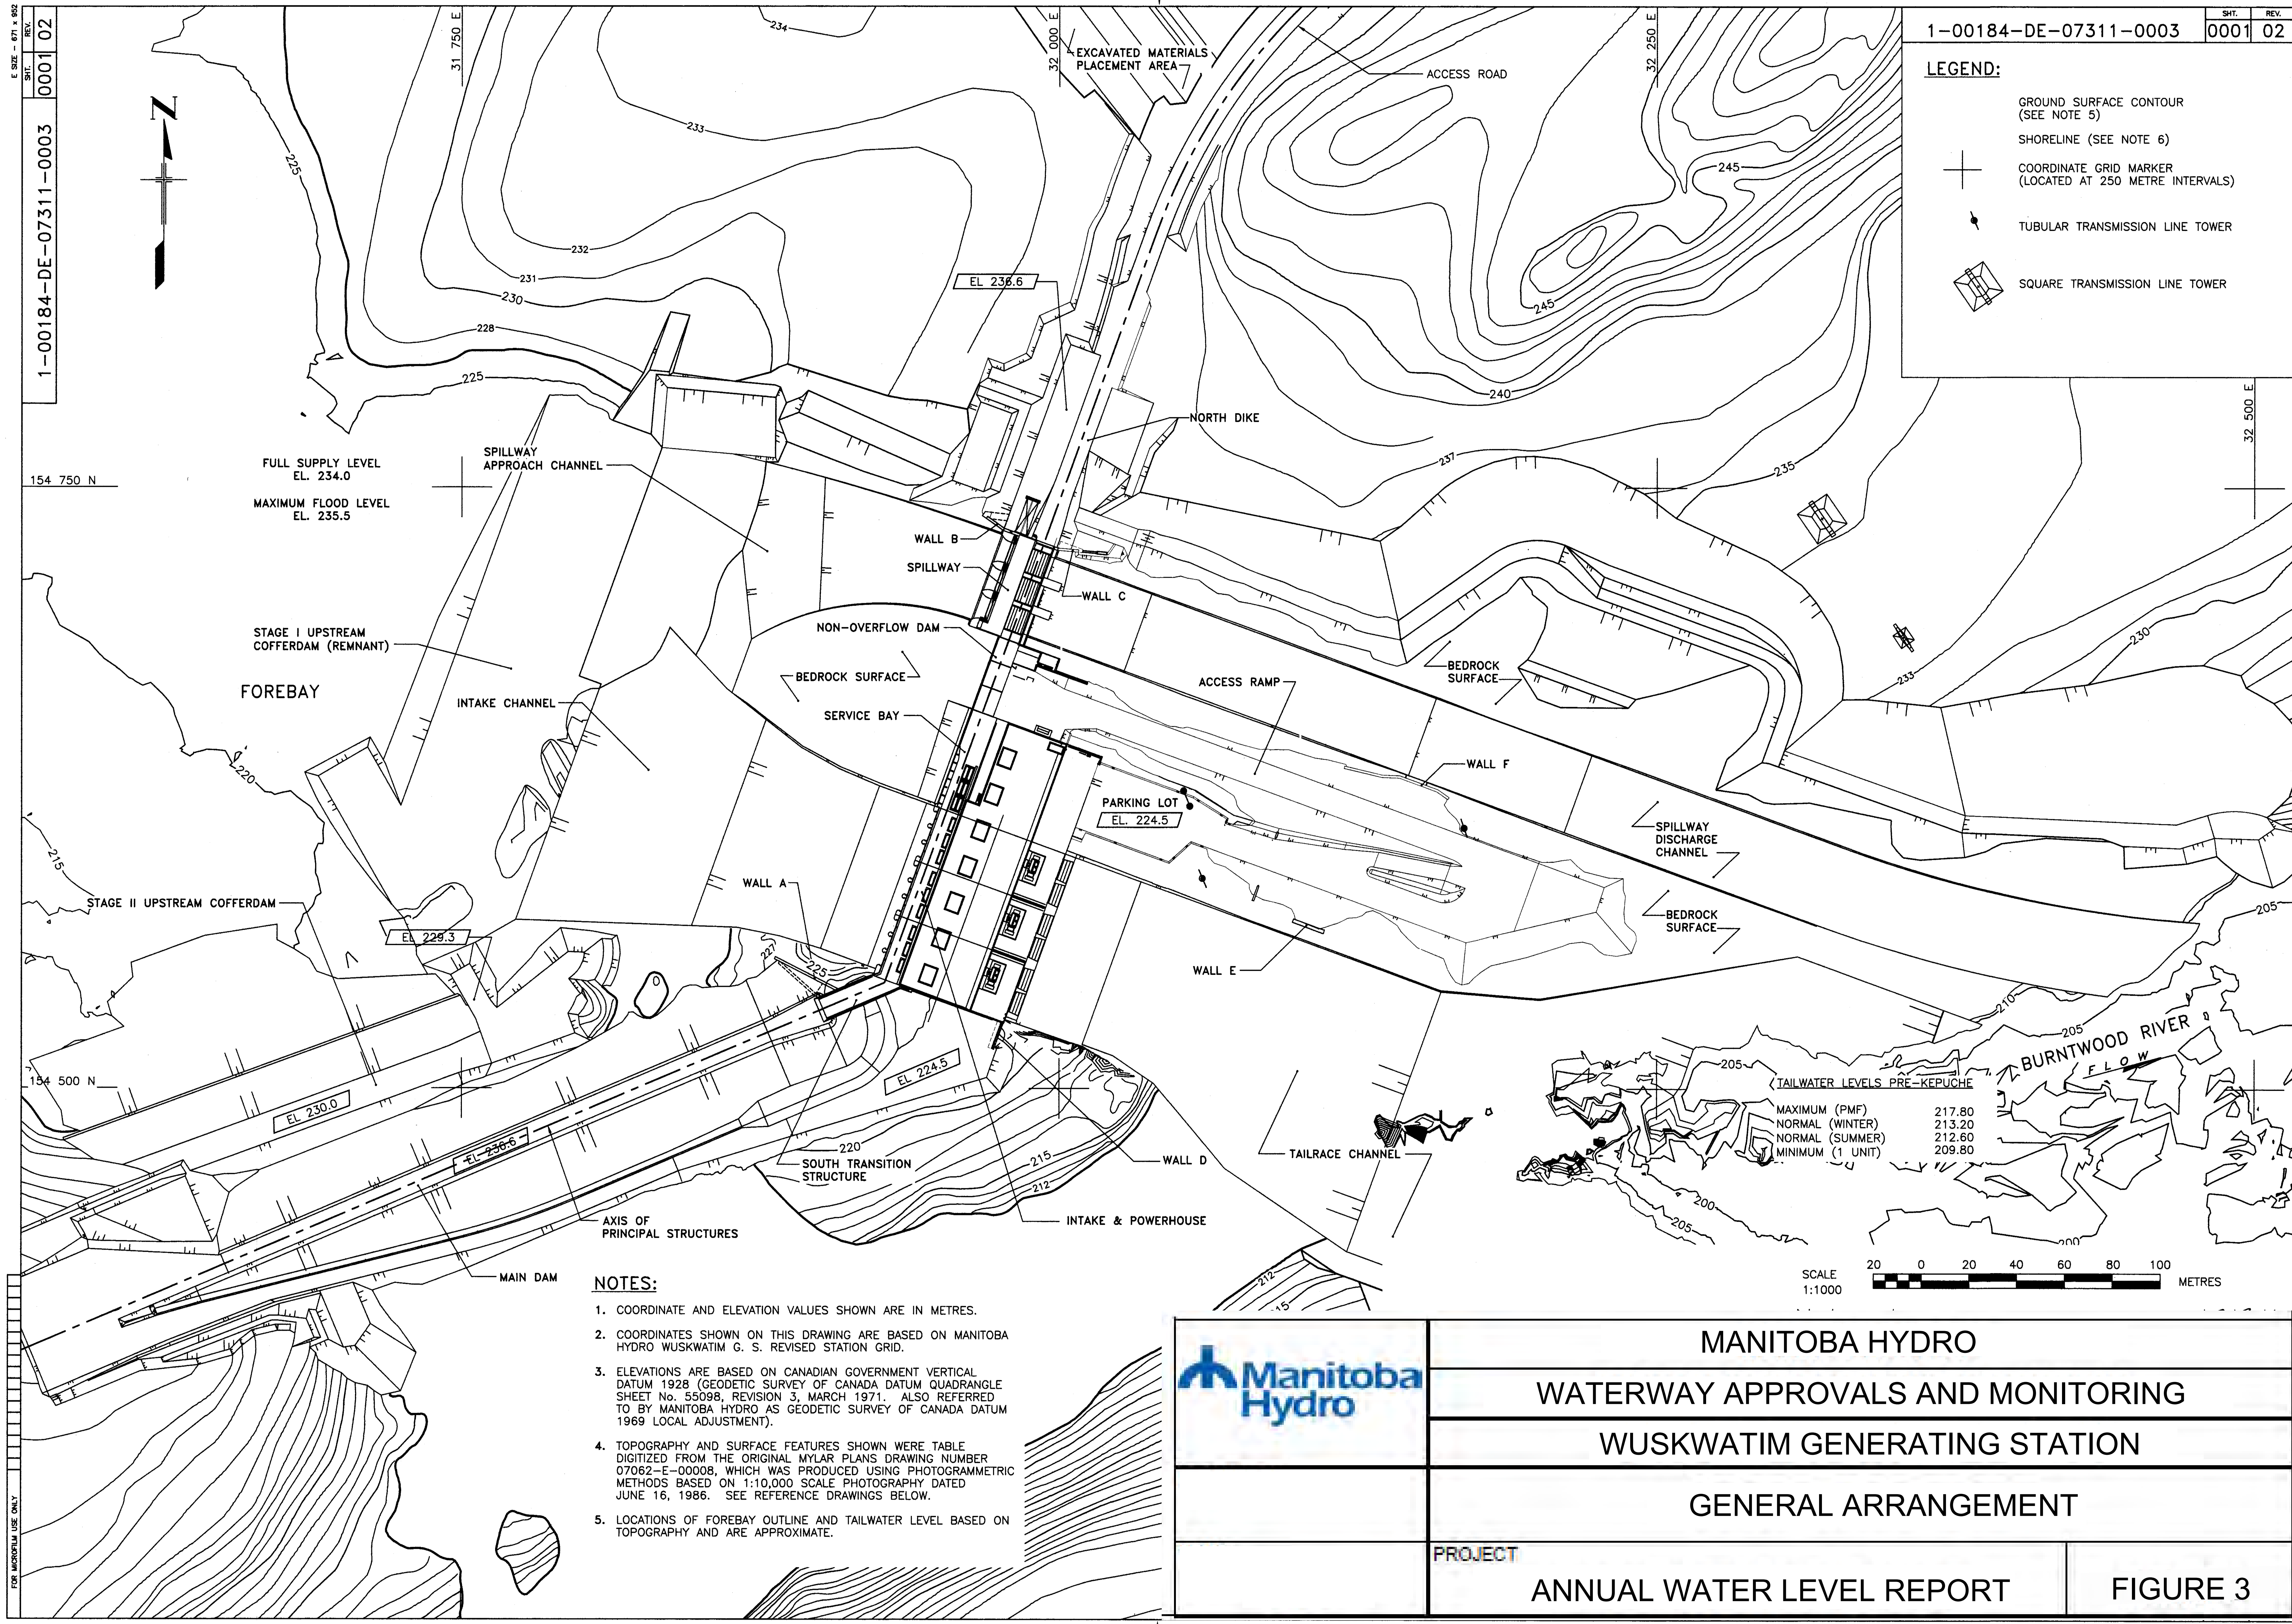

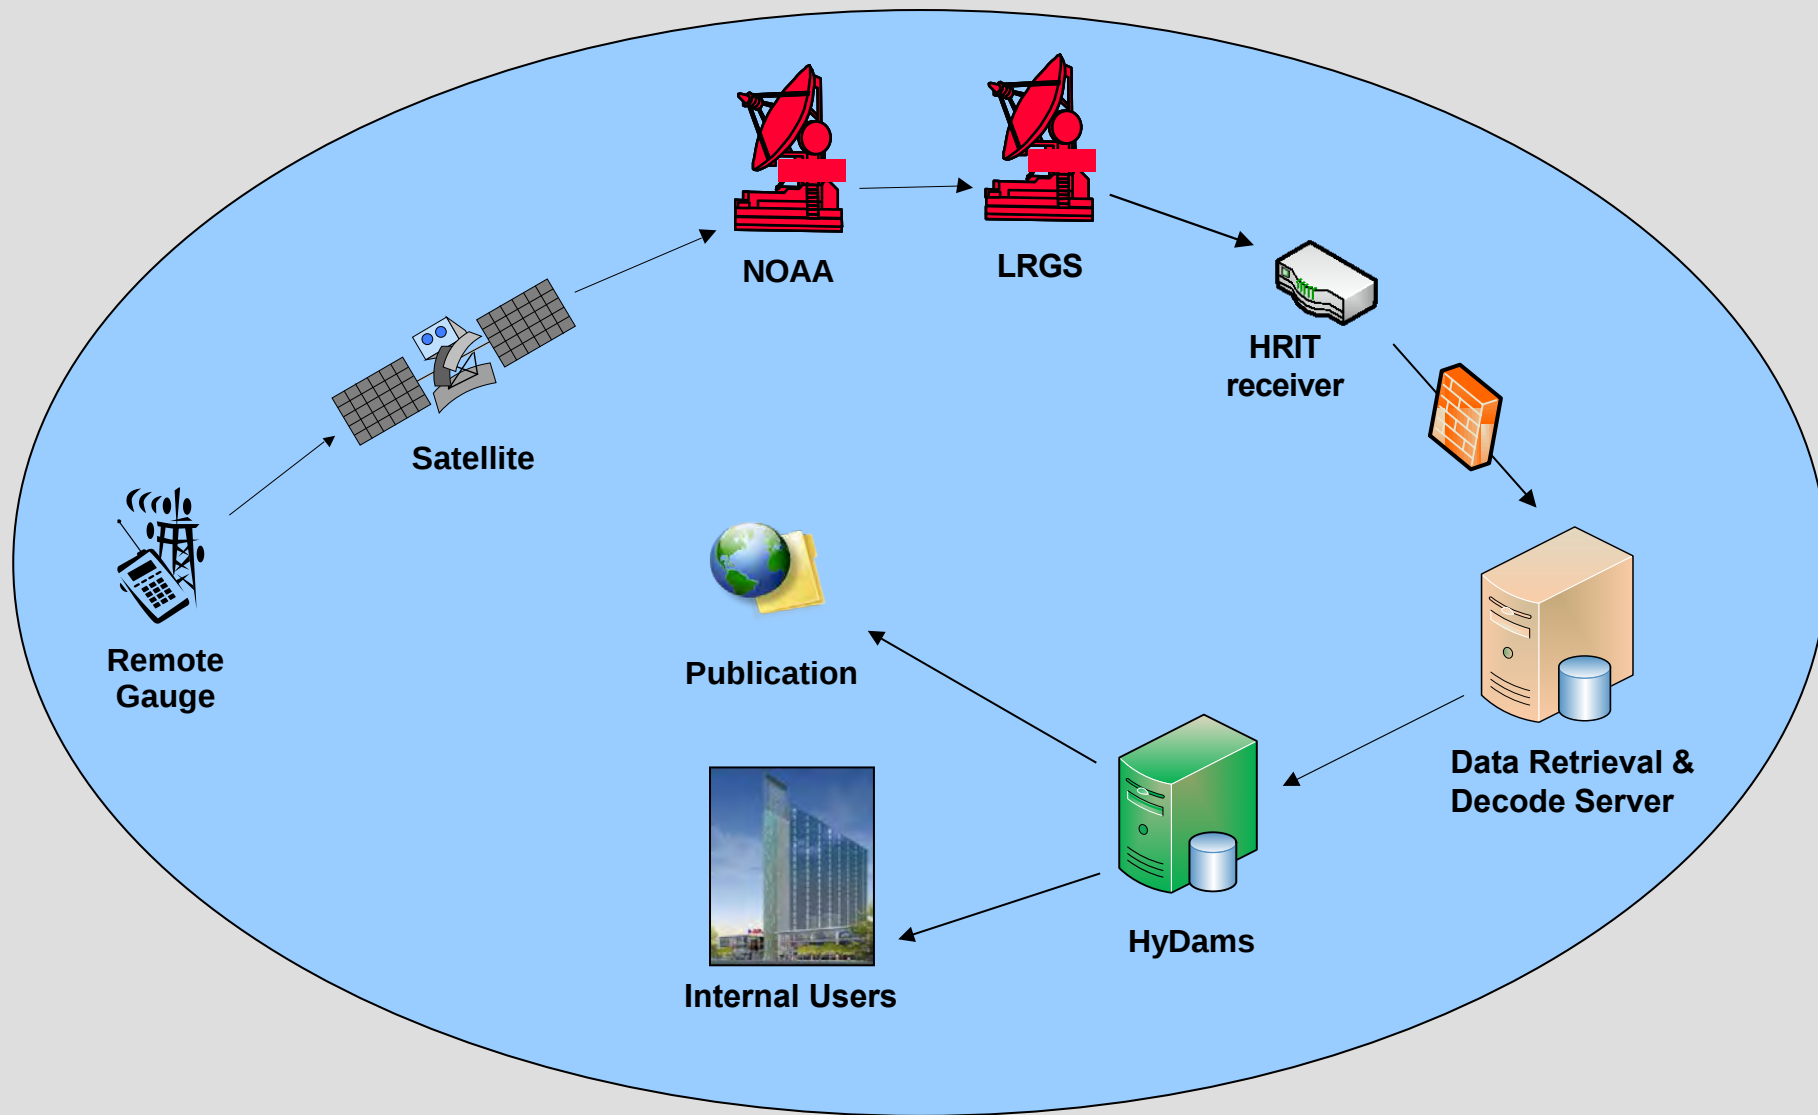

	MANITOBA HYDRO	
	WATERWAY APPROVALS AND MONITORING	
	HYDROLOGIC DATA ACQUISITION AND MANAGEMENT SYSTEM	
	REMOTE DATA PROCESS MAP	
	PROJECT	
	WATER LEVELS AND FLOWS REPORT	FIGURE 4


Wuskwatim Generating Station - Wuskwatim Lake Hourly Water Levels
Compliance Report for 2023

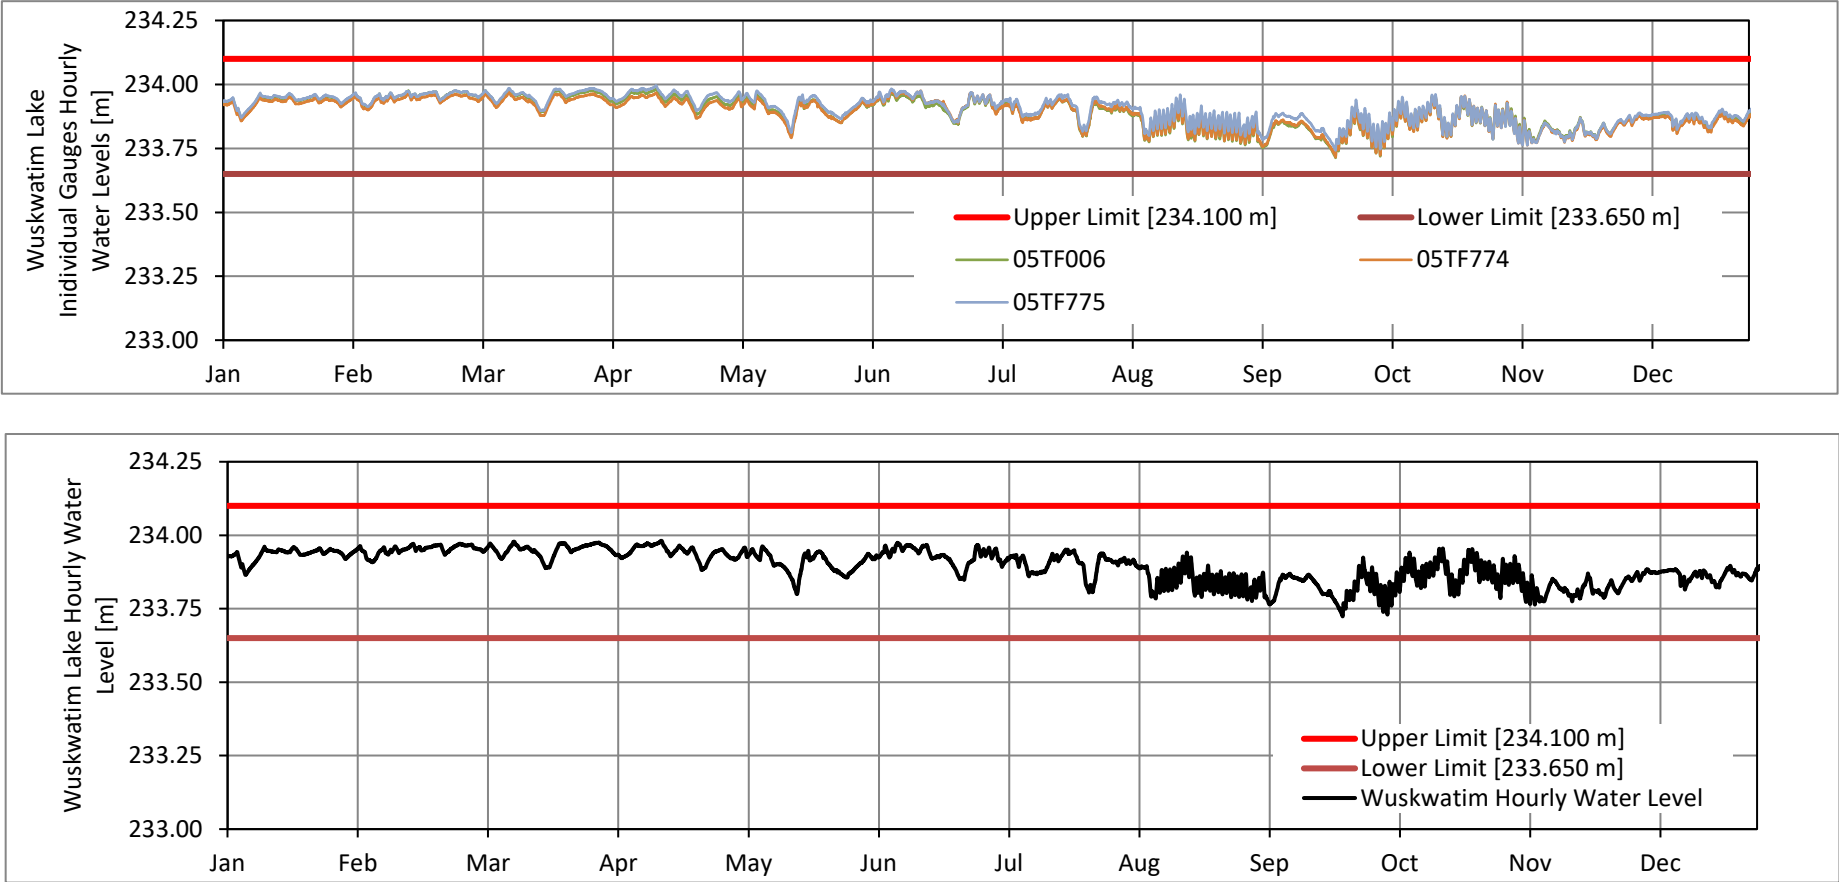

Note:
Wuskwatim Hourly Water Level is calculated using Wuskwatim Lake gauges
05TF006, 05TF774 & 05TF775.

	MANITOBA HYDRO	
	WATERWAY APPROVALS AND MONITORING	
	WUSKWATIM GENERATING STATION	
	WUSKWATIM LAKE HOURLY WL (2023)	
	PROJECT ANNUAL COMPLIANCE REPORT	FIGURE 5


Wuskwatim Generating Station - Wuskwatim Lake Mean Daily Water Level Compliance Report for 2023

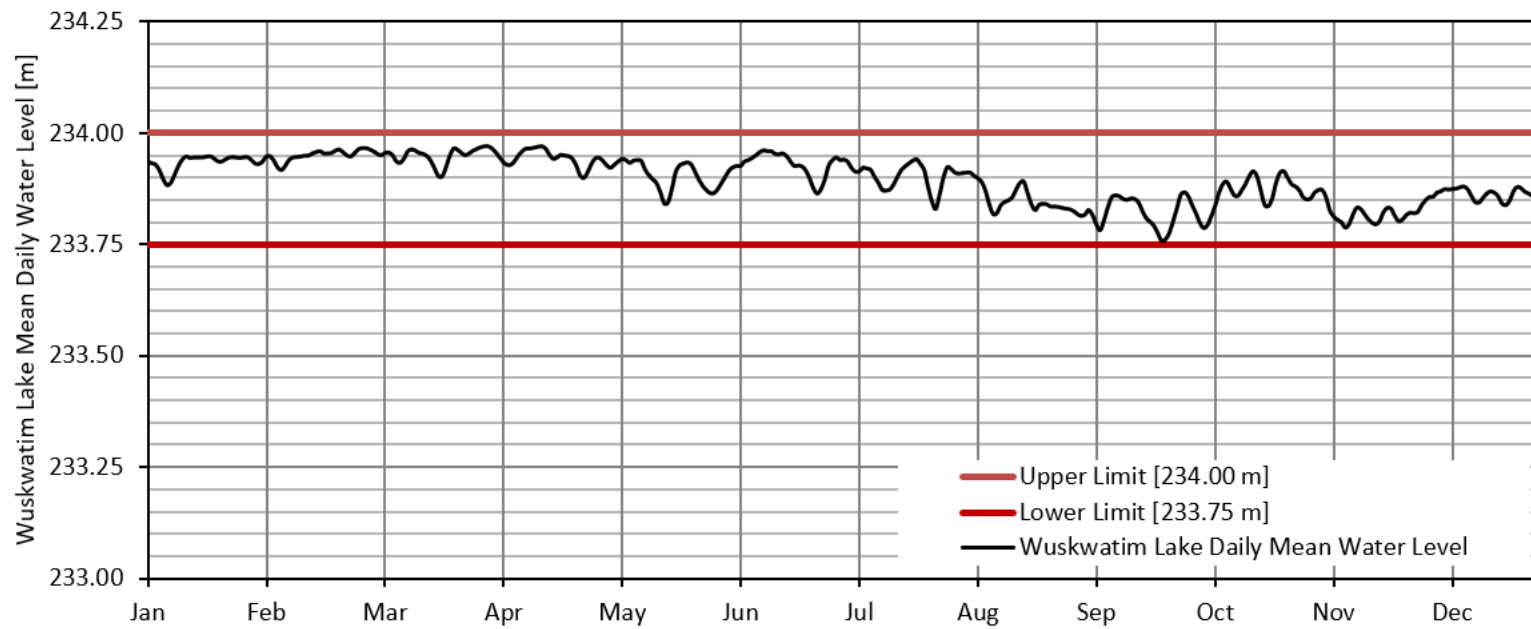

Note:
Wuskwatim Lake Mean Daily Water Level is calculated using Wuskwatim Lake gauges 05TF006, 05TF774 & 05TF775.

	MANITOBA HYDRO	
	WATERWAY APPROVALS AND MONITORING	
	WUSKWATIM GENERATING STATION	
	WUSKWATIM LAKE MEAN DAILY WL (2023)	
	PROJECT	
	ANNUAL COMPLIANCE REPORT	FIGURE 6

Wuskwatim Generating Station - Birch Tree Lake Daily Water Level Change Compliance Report for 2023

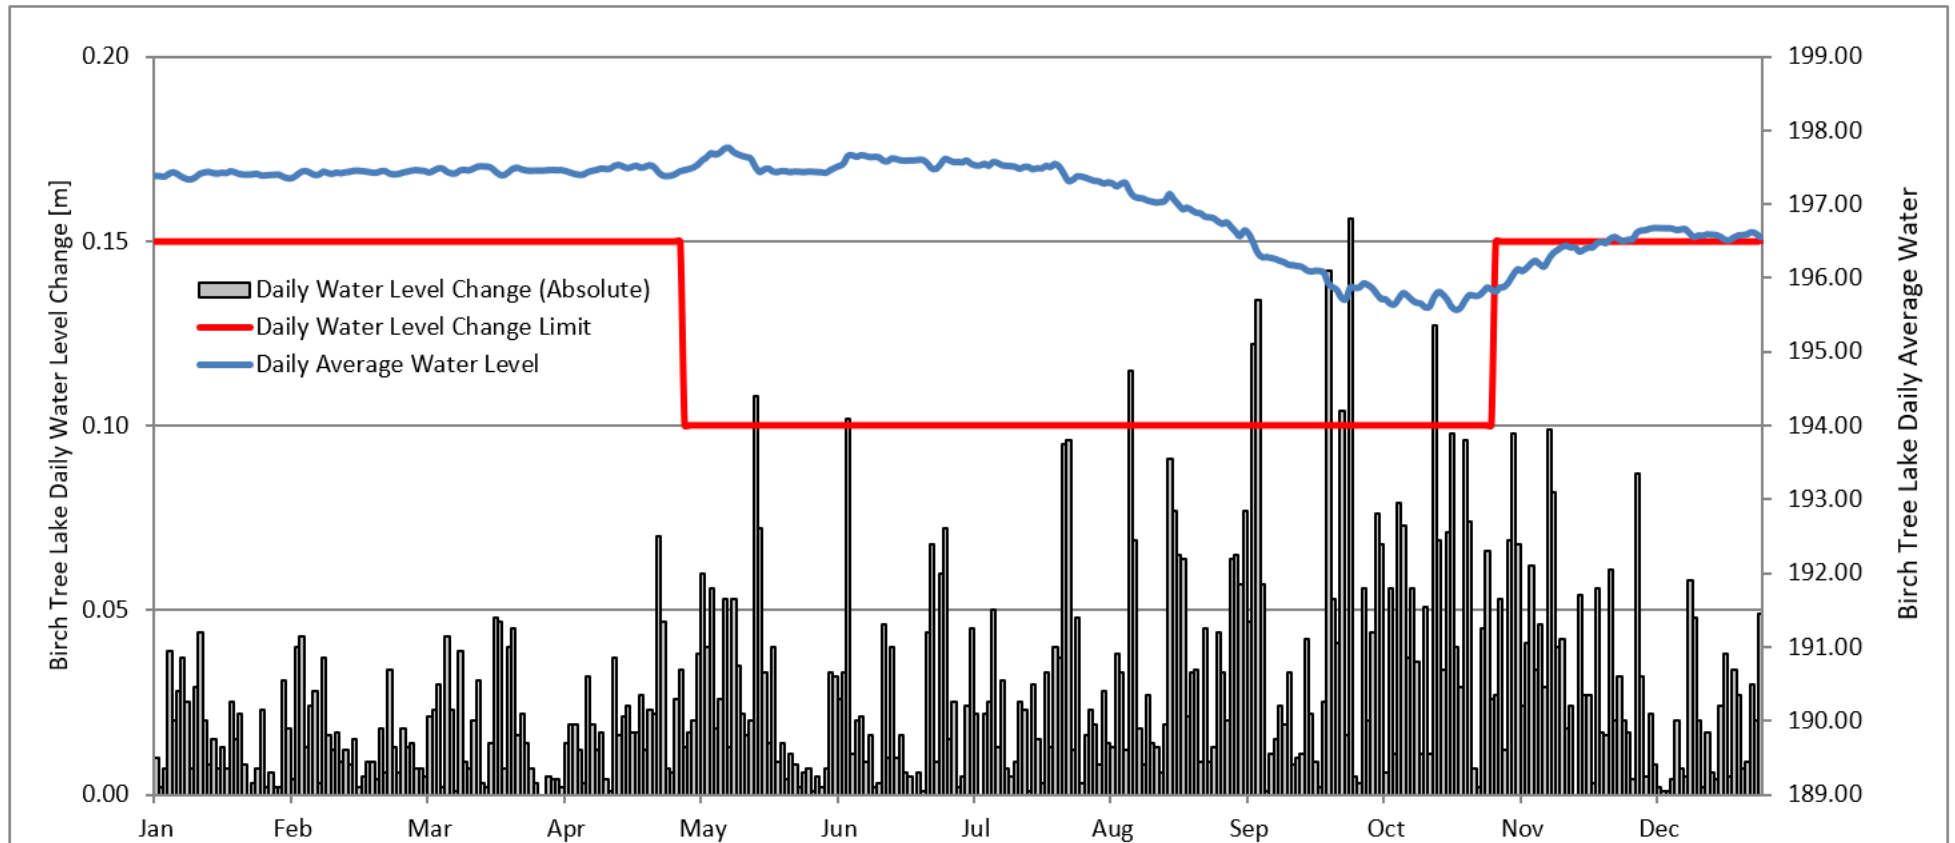

Note:

The Birch Tree Lake Daily Water Level Change is calculated using Birch Tree Lake gauges 05TG701 & 05TG746.

The daily water level change limit is equal to 0.1 m in open water conditions (May 1 to October 31) and 0.15 m in winter conditions

	MANITOBA HYDRO	
	WATERWAY APPROVALS AND MONITORING	
	WUSKWATIM GENERATING STATION	
	BIRCH TREE LAKE DAILY WL CHANGE (2023)	
	PROJECT ANNUAL COMPLIANCE REPORT	FIGURE 7

APPENDIX I

CORRESPONDENCE WITH

MANITOBA CONSERVATION AND CLIMATE CHANGE

2023 05 19

Ms. Agnes Wittman
Director, Environmental Approvals Branch
Manitoba Environment and Climate
EABDirector@gov.mb.ca

Dear Ms. Wittman:

**WUSKWATIM GENERATING STATION ENVIRONMENT ACT LICENCE – BIRCH
TREE LAKE – MEAN DAILY WATER LEVEL VARIATION ABOVE LICENCE LIMIT**

On May 10, 2023, the mean daily water level variation on Birch Tree Lake was above the licence limit specified in clause 30 (b) of The Environment Act Licence No. 2699.

The Birch Tree Lake daily water level change was 0.18 metres on May 10, 2022 (Figure 1). Clause 30(b) of The Environment Act Licence No. 2699 limits mean daily water level variations on Birch Tree Lake to 0.10 m under open water conditions. Waterway Approvals and Monitoring Department is investigating the incident and we will advise you of the outcome.

If you have any questions about this matter, please call me at (204) 360-3018.


Yours truly,



W.V. Penner, P.Eng
Manager, Waterway Approvals and Monitoring Department

PGC/00184-07311-0089_00.docx
Att.

Figure 1: Birch Tree Lake Daily Water Level Change - 7 Day Elevation Licence Compliance

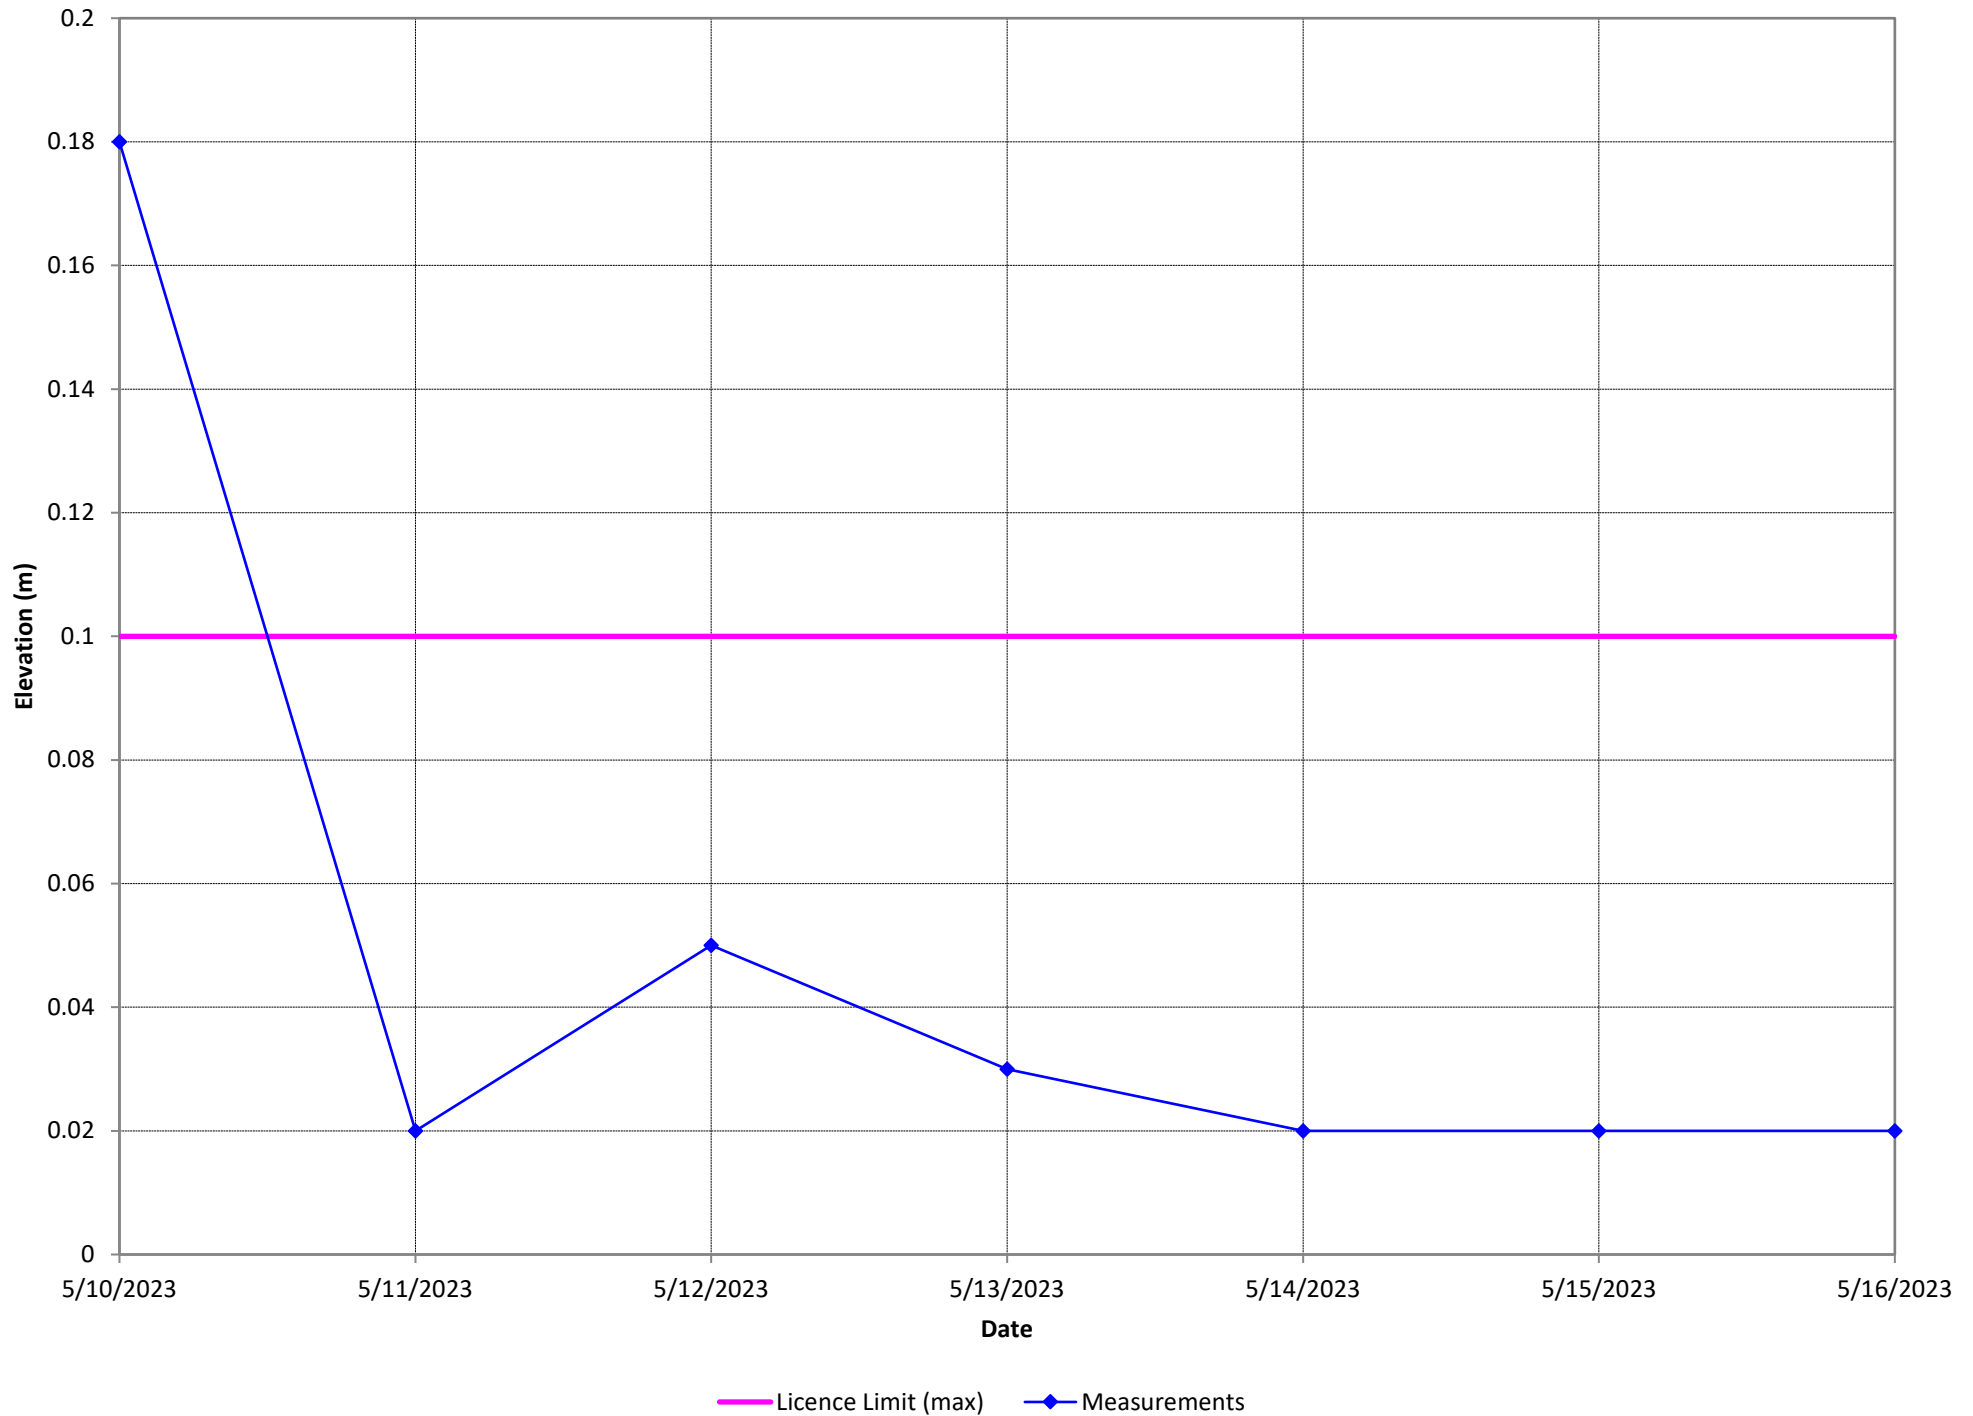

2023 05 26

Ms. Agnes Wittman
Director, Environmental Approvals Branch
Manitoba Environment and Climate
EABDirector@gov.mb.ca

Dear Ms. Wittman:

**WUSKWATIM GENERATING STATION ENVIRONMENT ACT LICENCE – BIRCH
TREE LAKE – MEAN DAILY WATER LEVEL VARIATION ABOVE LICENCE LIMIT**

On May 10, 2023, the mean daily water level variation on Birch Tree Lake was 0.18 m (Figure 1). This is above the open water licence limit of 0.10 m specified in clause 30 (b) of The Environment Act Licence No. 2699.

This incident took place during the scheduled removal of Unit 3 from service for 3-year maintenance. To maintain Wuskwatim Lake water level, a corresponding amount of spill was initiated simultaneously. Additionally, there was a rapid rise in temperature leading to accelerated snowmelt and increased runoff in the local basin. The combined impact of these factors led to the change in daily water level at Birch Tree Lake beyond the licence limit.

Hydraulic modelling determined that Wuskwatim Generating Station operations would have caused a Birch Tree Lake daily change of 0.10 m. For this reason, the May 10 incident is not considered a licence violation.

If you have any questions about this matter, please call me at (204) 360-3018.

Yours truly,


Original signed by: *Wes Penner*

W.V. Penner, P. Eng
Manager, Waterway Approvals and Monitoring Department

AM/00184-07311-0091_00.docx

Att.

Figure 1: Birch Tree Lake Daily Water Level Change - 7 Day Elevation Licence Compliance

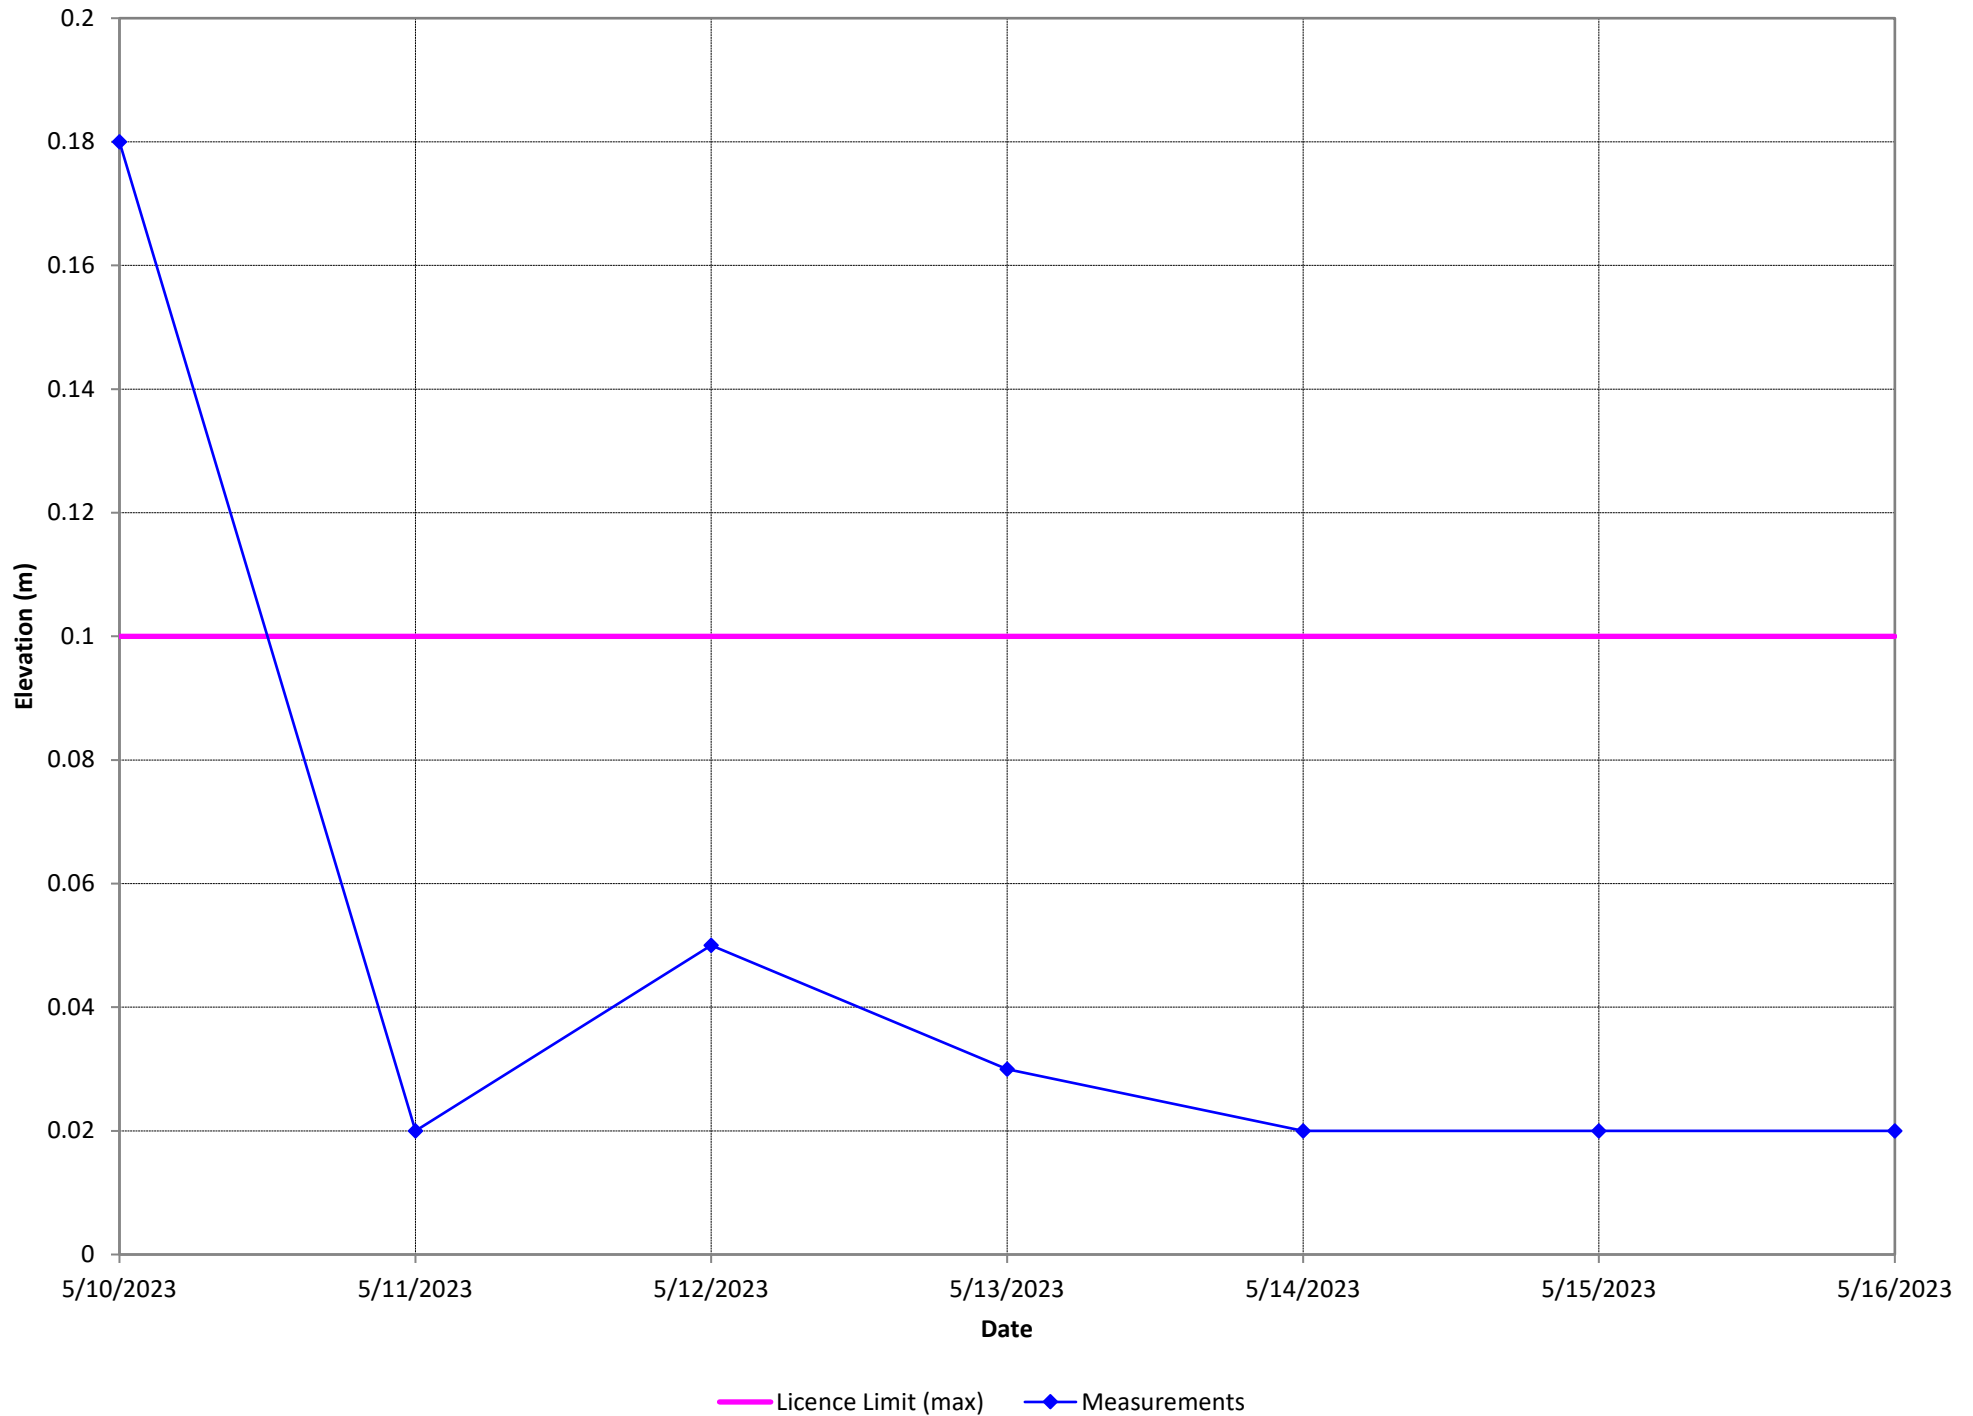

2023 05 25

Ms. Agnes Wittman
Director, Environmental Approvals Branch
Manitoba Environment and Climate
EABDirector@gov.mb.ca

Dear Ms. Wittman:

**WUSKWATIM GENERATING STATION ENVIRONMENT ACT LICENCE – BIRCH
TREE LAKE – MEAN DAILY WATER LEVEL VARIATION ABOVE LICENCE LIMIT**

On May 17, 2023, the mean daily water level variation on Birch Tree Lake was above the licence limit specified in clause 30 (b) of The Environment Act Licence No. 2699.

The Birch Tree Lake daily water level change was 0.11 metres on May 17, 2023 (Figure 1). Clause 30(b) of The Environment Act Licence No. 2699 limits mean daily water level variations on Birch Tree Lake to 0.10 m under open water conditions. Waterway Approvals and Monitoring Department is investigating the incident and we will advise you of the outcome.

If you have any questions about this matter, please call me at (204) 360-3018.


Yours truly,

Original signed by: *Wes Penner*

W.V. Penner, P.Eng
Manager, Waterway Approvals and Monitoring Department

PGC/00184-07311-0090_00.docx
Att.

Birch Tree Lake Daily ROC -- 7 Day Elevation Licence Compliance

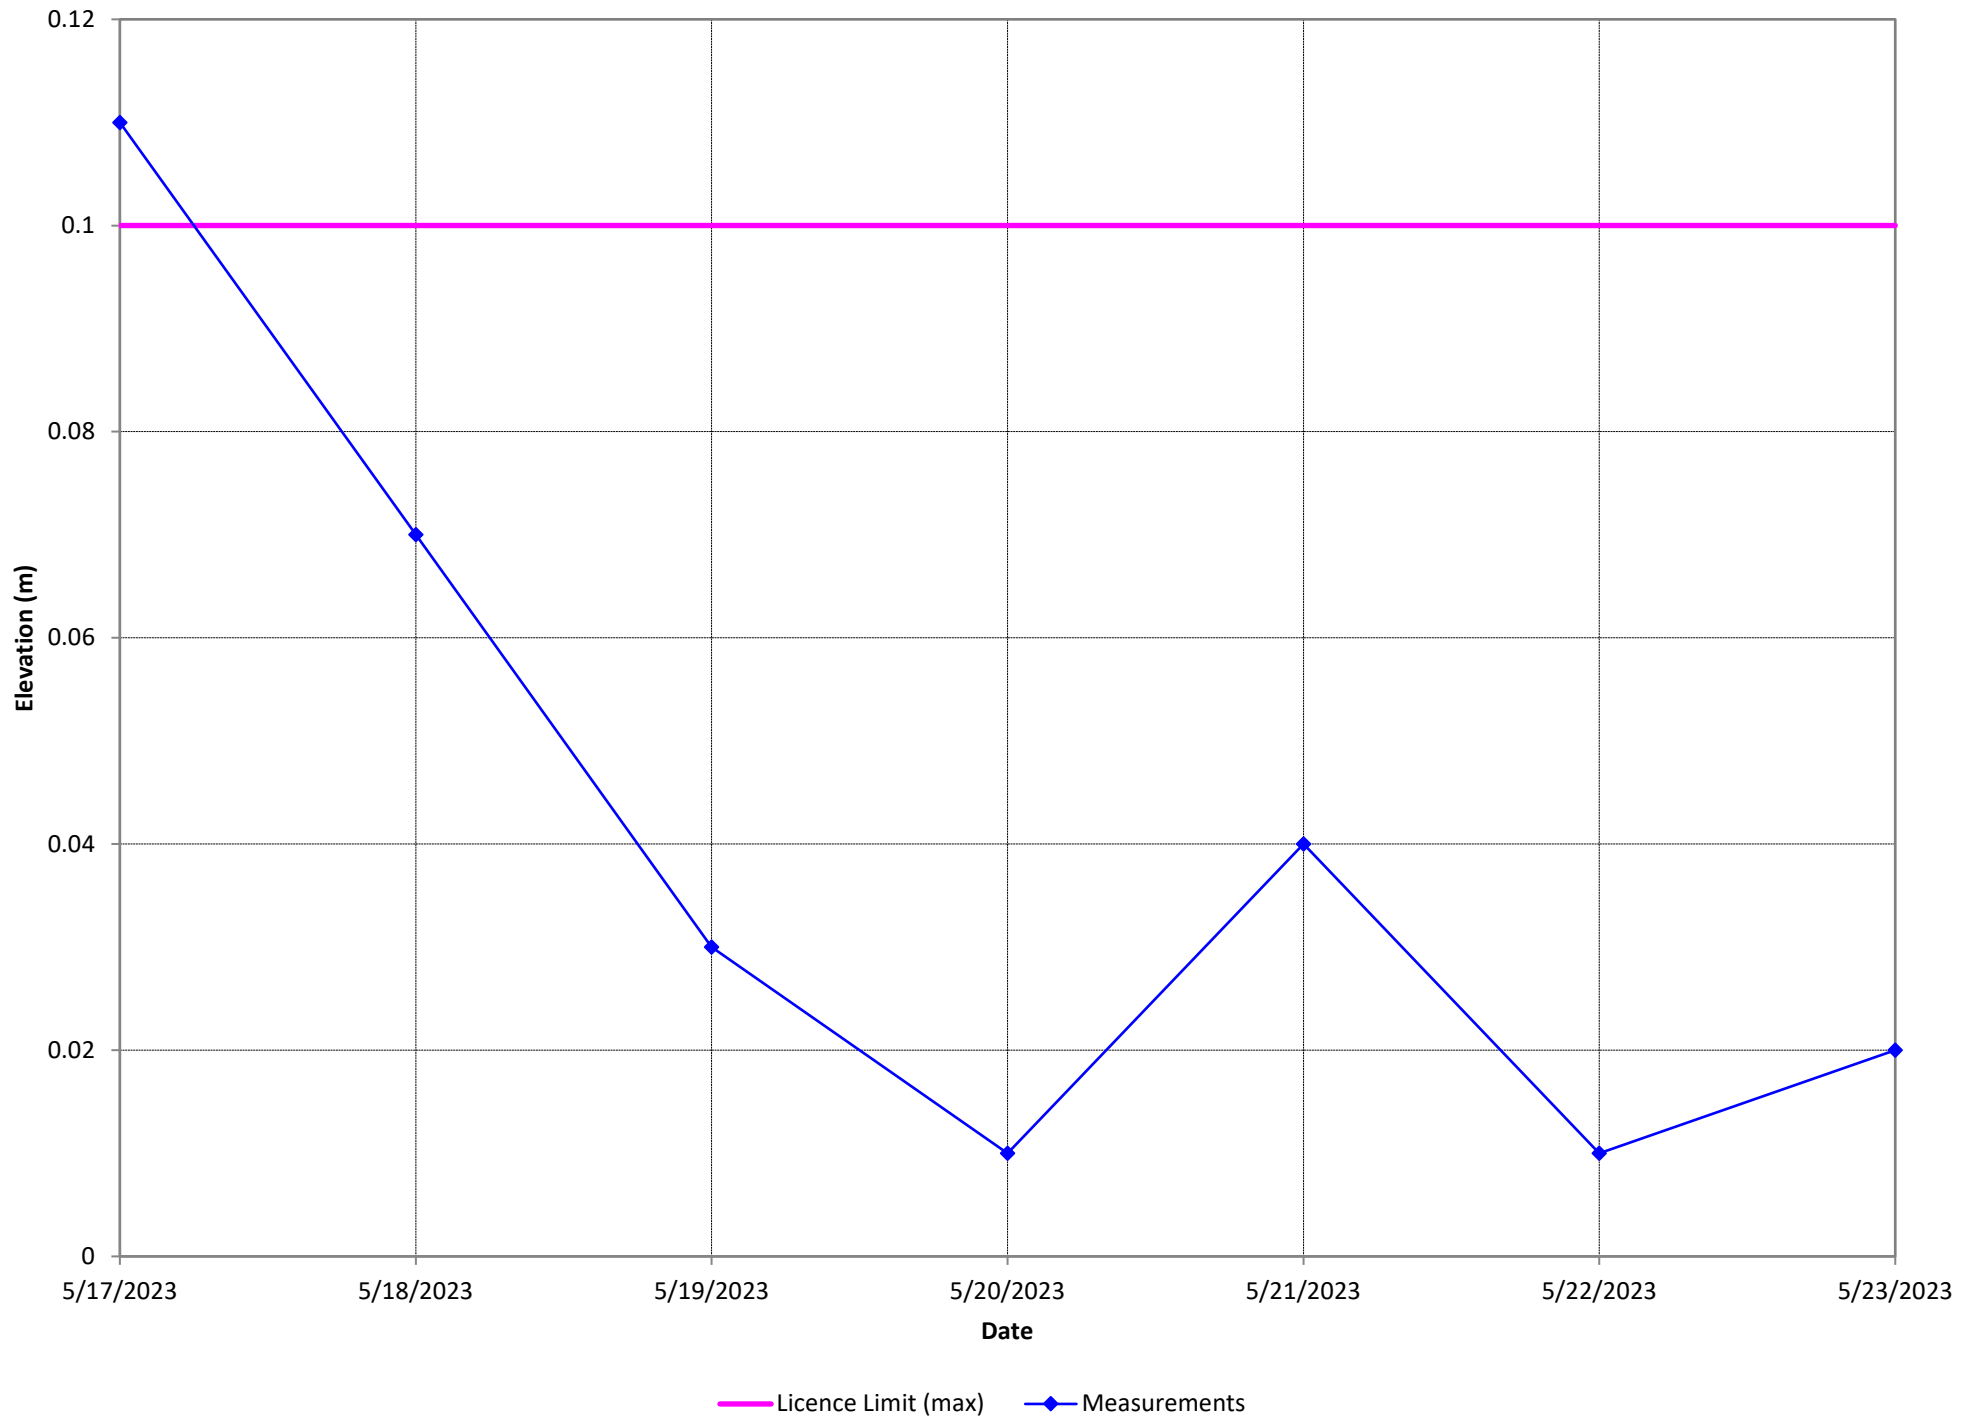

2023 06 05

Ms. Agnes Wittman
Director, Environmental Approvals Branch
Manitoba Environment and Climate
EABDirector@gov.mb.ca

Dear Ms. Wittman:

**WUSKWATIM GENERATING STATION ENVIRONMENT ACT LICENCE – BIRCH
TREE LAKE – MEAN DAILY WATER LEVEL VARIATION ABOVE LICENCE LIMIT**

On May 17, 2023, the mean daily water level variation on Birch Tree Lake was 0.11 m (Figure 1). This is above the open water licence limit of 0.10 m specified in clause 30 (b) of Environment Act Licence No. 2699.

This incident took place when the Wuskwatim outflow was decreased to store water in the forebay. The reduction in daily mean outflow was kept below the established threshold of 80 cubic metres per second, meant to prevent water levels variations at Birch Tree Lake from exceeding the licence limit. However, the reduction in outflow still resulted in a water level drop of 0.11 m in Birch Tree Lake.

Manitoba Hydro continues to actively work to improve operations and minimize the occurrence of license limit exceedances in Birch Tree Lake.

If you have any questions about this matter, please call me at (204) 360-3018.

Yours truly,


Original signed by: *Wes Penner*

W.V. Penner, P. Eng
Manager, Waterway Approvals and Monitoring Department

AM/00184-07311-0092_00.docx

Att.

Birch Tree Lake Daily ROC -- 7 Day Elevation Licence Compliance

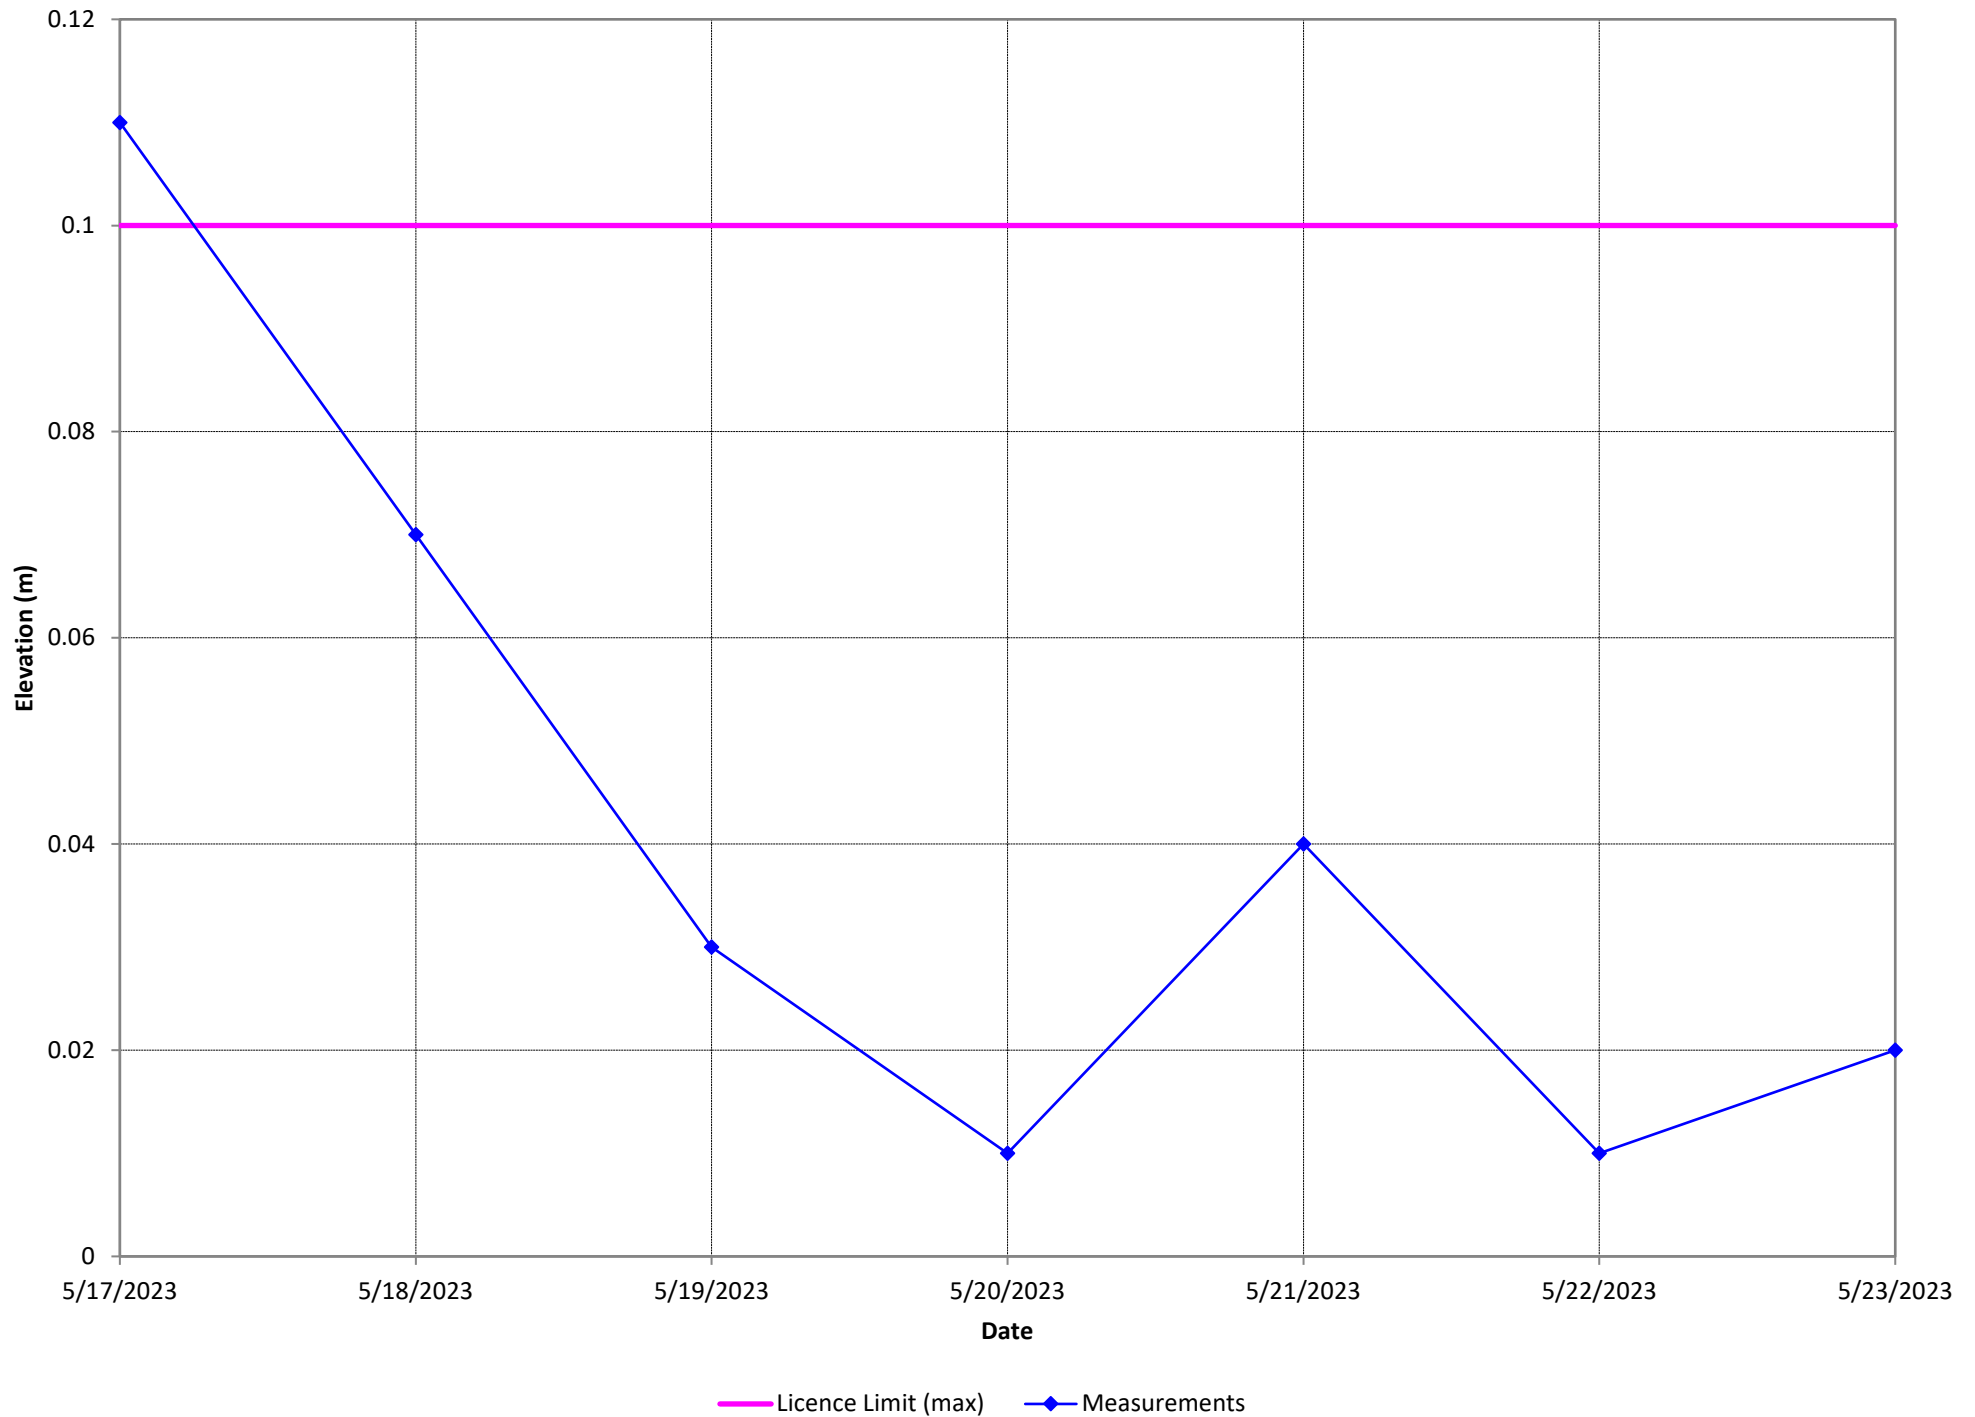

2023 08 17

Ms. Agnes Wittman
Director, Environmental Approvals Branch
Manitoba Environment and Climate
EABDirector@gov.mb.ca

Dear Ms. Wittman:

**WUSKWATIM GENERATING STATION ENVIRONMENT ACT LICENCE – BIRCH
TREE LAKE – MEAN DAILY WATER LEVEL VARIATION ABOVE LICENCE LIMIT**

On August 10, 2023, the mean daily water level variation on Birch Tree Lake was above the licence limit specified in clause 30 (b) of The Environment Act Licence No. 2699.

The Birch Tree Lake daily water level change was 0.12 metres on August 10, 2023 (Figure 1). Clause 30(b) of The Environment Act Licence No. 2699 limits mean daily water level variations on Birch Tree Lake to 0.10 m under open water conditions. Waterway Approvals and Monitoring Department is investigating the incident and we will advise you of the outcome.

If you have any questions about this matter, please call me at (204) 360-3018.

Yours truly,

Original signed by: *Wes Penner*

W.V. Penner, P.Eng
Manager, Waterway Approvals and Monitoring Department

KMP/00184-07311-0093_00.docx
Att.

2023 09 15

Ms. Agnes Wittman
Director, Environmental Approvals Branch
Manitoba Environment and Climate
EABDirector@gov.mb.ca

Dear Ms. Wittman:

**WUSKWATIM GENERATING STATION ENVIRONMENT ACT LICENCE – BIRCH
TREE LAKE – MEAN DAILY WATER LEVEL VARIATION ABOVE LICENCE LIMIT**

On August 10, 2023, the mean daily water level variation on Birch Tree Lake was 0.12 m (Figure 1). This is above the open water licence limit of 0.10 m specified in clause 30 (b) of The Environment Act Licence No. 2699.

Hydraulic modelling shows that the exceedance was a direct result of the operation of the Wuskwatim Generating Station (G.S.) during a change in the cycling pattern.

In response to decreased flows on the Burntwood River, a three-to-two-unit operating cycling pattern was initiated at Wuskwatim Generating Station on August 8, 2023. Despite limiting the daily average flow change to 80 cms, the transition from constant discharge operation to unit cycling operation caused the water levels at Birch Tree Lake to drop and produce a daily water level change greater than 0.10 m on August 10, 2023. Manitoba Hydro is investigating operating limits that may prevent a recurrence of this type of licence exceedance in the future.

If you have any questions about this matter, please call me at (204) 360-3018.

Yours truly,



W.V. Penner, P.Eng
Manager, Waterway Approvals and Monitoring Department

KMP/00184-07311-0094_00.docx

2023 09 14

Ms. Agnes Wittman
Director, Environmental Approvals Branch
Manitoba Environment and Climate
EABDirector@gov.mb.ca

Dear Ms. Wittman:

**WUSKWATIM GENERATING STATION ENVIRONMENT ACT LICENCE – BIRCH
TREE LAKE – MEAN DAILY WATER LEVEL VARIATION ABOVE LICENCE LIMIT**

On September 7, 2023 and September 8, 2023, the mean daily water level variation on Birch Tree Lake was above the licence limit specified in clause 30 (b) of The Environment Act Licence No. 2699.

The Birch Tree Lake daily water level change was 0.12 metres on September 7, 2023, and 0.13 metres on September 8, 2023 (Figure 1). Clause 30(b) of The Environment Act Licence No. 2699 limits mean daily water level variations on Birch Tree Lake to 0.10 m under open water conditions. Waterway Approvals and Monitoring Department is investigating the incident and we will advise you of the outcome.

If you have any questions about this matter, please call me at (204) 360-3018.


Yours truly,



W.V. Penner, P.Eng
Manager, Waterway Approvals and Monitoring Department

KMP/00184-07311-0095_00.docx
Att.

Birch Tree Lake Daily ROC -- 7 Day Elevation Licence Compliance

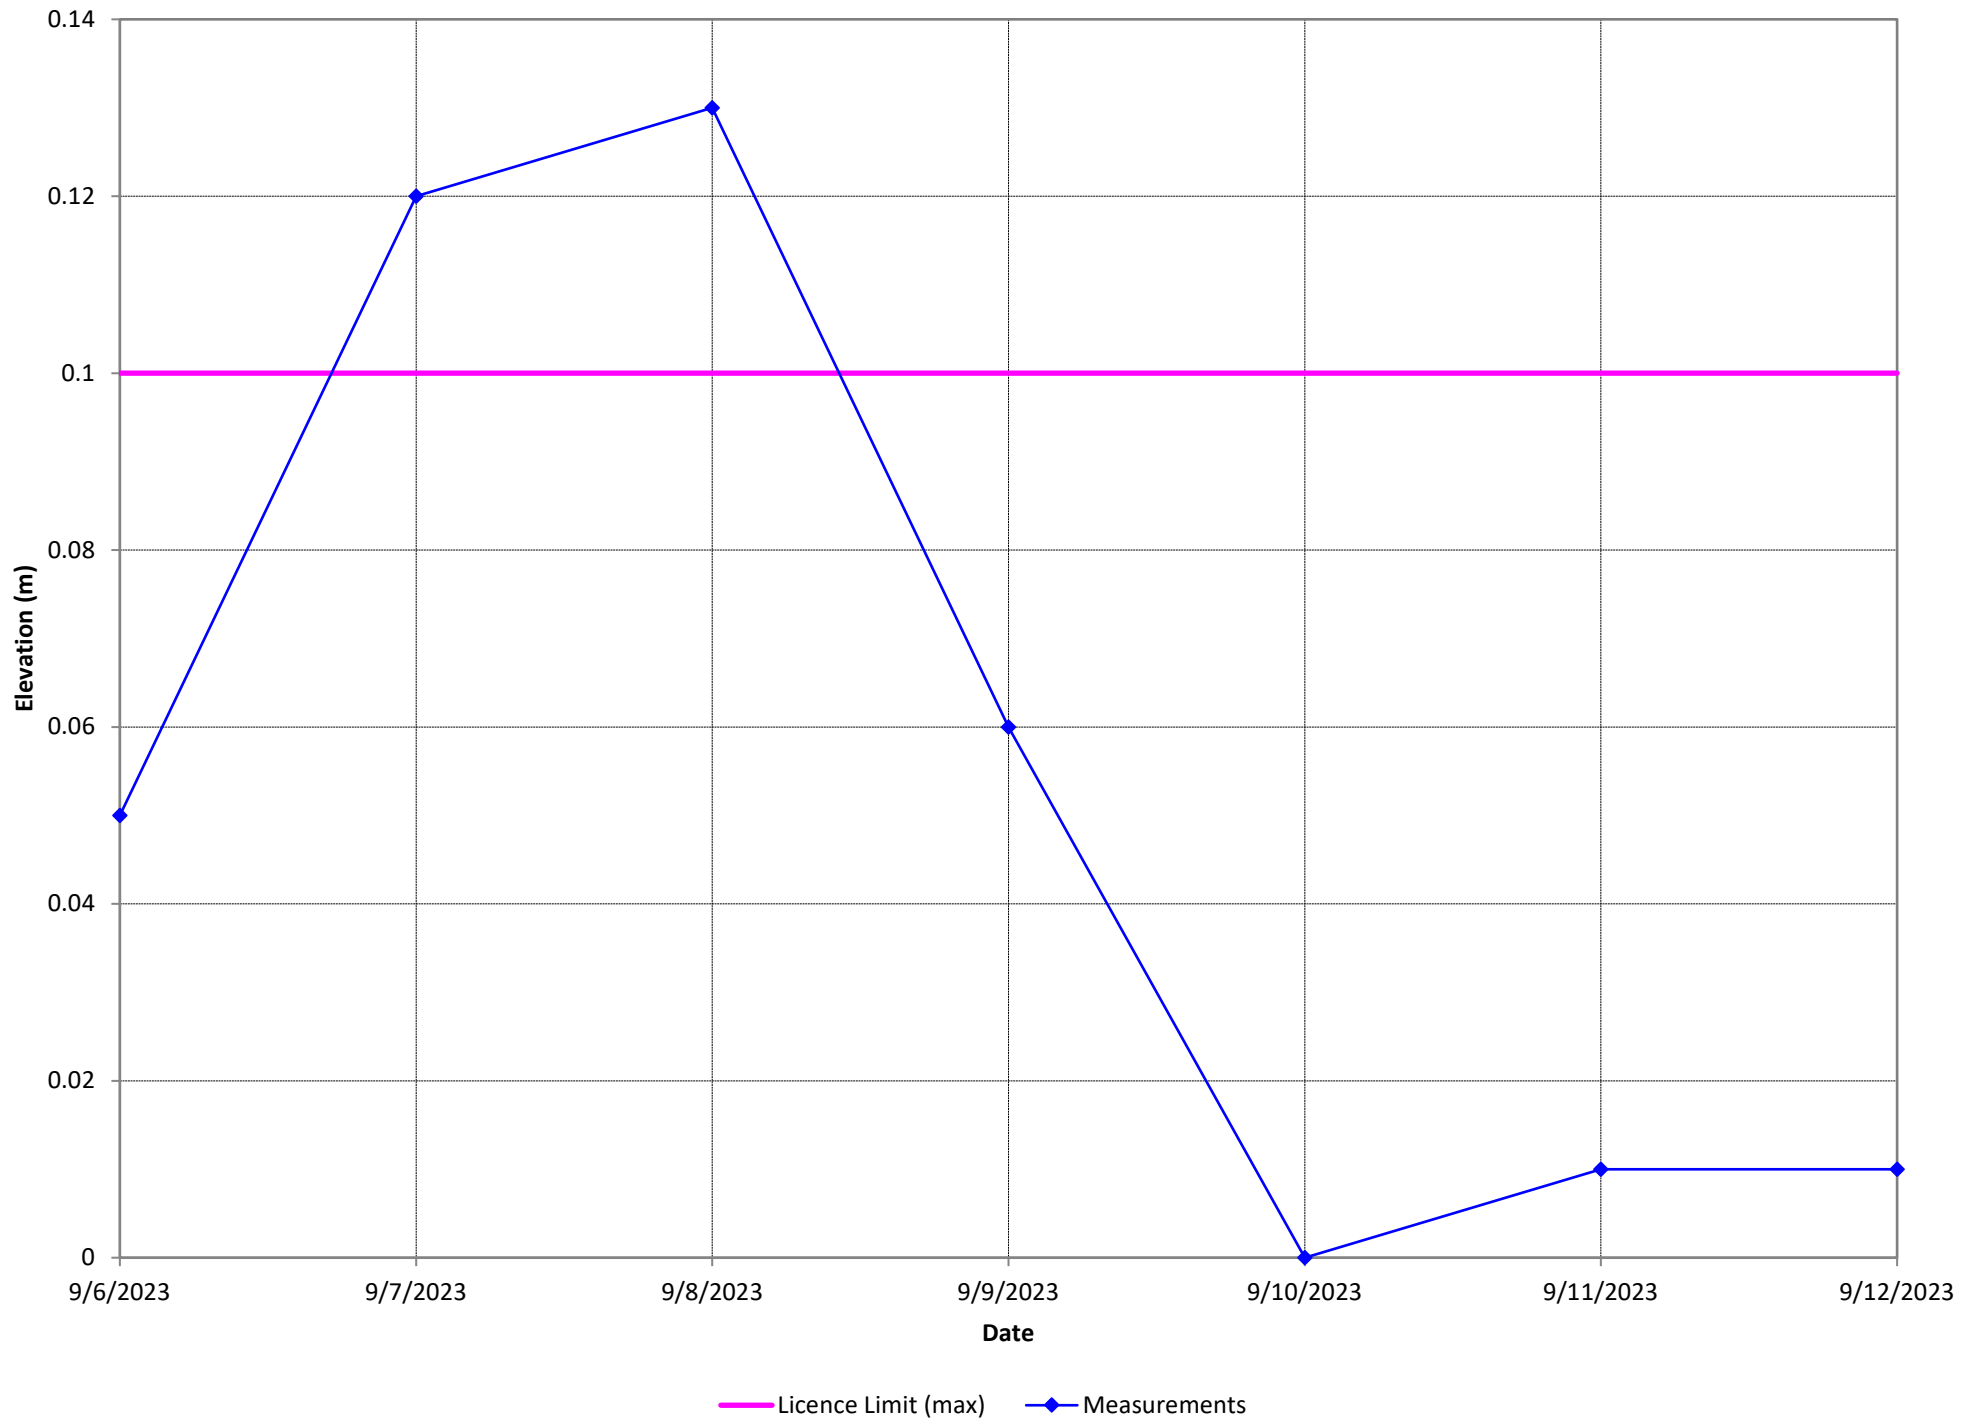

2023 09 28

Ms. Agnes Wittman
Director, Environmental Approvals Branch
Manitoba Environment and Climate
EABDirector@gov.mb.ca

Dear Ms. Wittman:

**WUSKWATIM GENERATING STATION ENVIRONMENT ACT LICENCE – BIRCH
TREE LAKE – MEAN DAILY WATER LEVEL VARIATION ABOVE LICENCE LIMIT**

On September 24, 2023, the mean daily water level variation on Birch Tree Lake was above the licence limit specified in clause 30 (b) of The Environment Act Licence No. 2699.

The Birch Tree Lake daily water level change was 0.14 metres on September 24, 2023 (Figure 1). Clause 30(b) of The Environment Act Licence No. 2699 limits mean daily water level variations on Birch Tree Lake to 0.10 m under open water conditions. Waterway Approvals and Monitoring Department is investigating the incident and we will advise you of the outcome.

If you have any questions about this matter, please call me at (204) 360-3018.

Yours truly,




W.V. Penner, P.Eng
Manager, Waterway Approvals and Monitoring Department

KMP/00184-07311-0097_00.docx

Att.

Birch Tree Lake Daily ROC -- 7 Day Elevation Licence Compliance

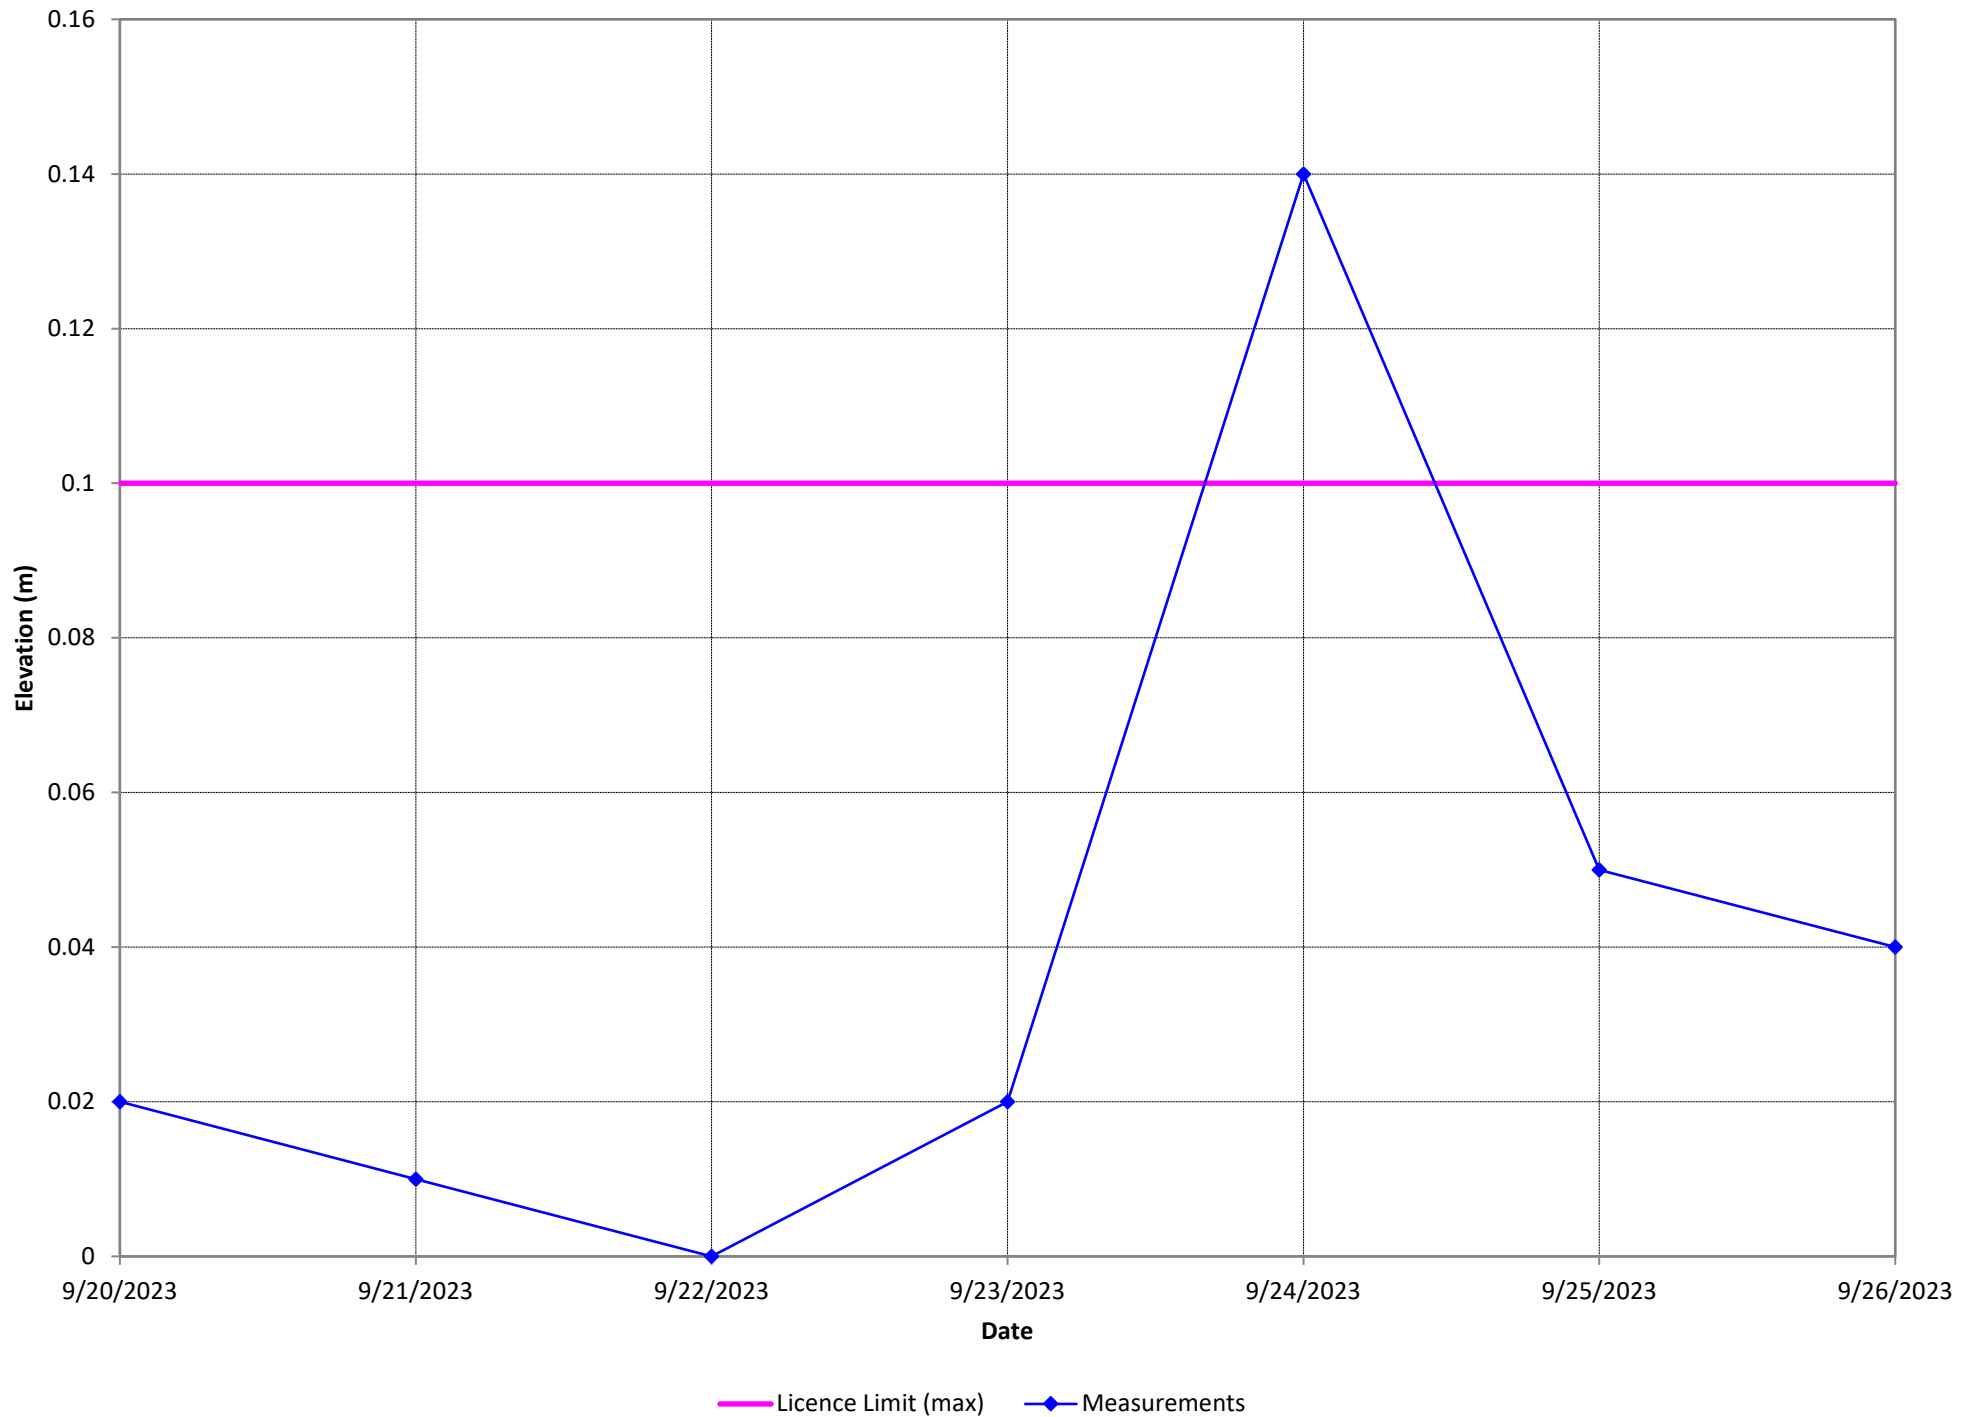

2023 10 05

Ms. Agnes Wittman
Director, Environmental Approvals Branch
Manitoba Environment and Climate
EABDirector@gov.mb.ca

Dear Ms. Wittman:

**WUSKWATIM GENERATING STATION ENVIRONMENT ACT LICENCE – BIRCH
TREE LAKE – MEAN DAILY WATER LEVEL VARIATION ABOVE LICENCE LIMIT**

On September 29, 2023, the mean daily water level variation on Birch Tree Lake was above the licence limit specified in clause 30 (b) of The Environment Act Licence No. 2699.

The Birch Tree Lake daily water level change was 0.16 metres on September 29, 2023 (Figure 1). Clause 30(b) of The Environment Act Licence No. 2699 limits mean daily water level variations on Birch Tree Lake to 0.10 m under open water conditions. Waterway Approvals and Monitoring Department is investigating the incident and we will advise you of the outcome.

If you have any questions about this matter, please call me at (204) 360-3018.


Yours truly,



W.V. Penner, P.Eng
Manager, Waterway Approvals and Monitoring Department

KMP/00184-07311-0099_00.docx
Att.

Birch Tree Lake Daily ROC -- 7 Day Elevation Licence Compliance

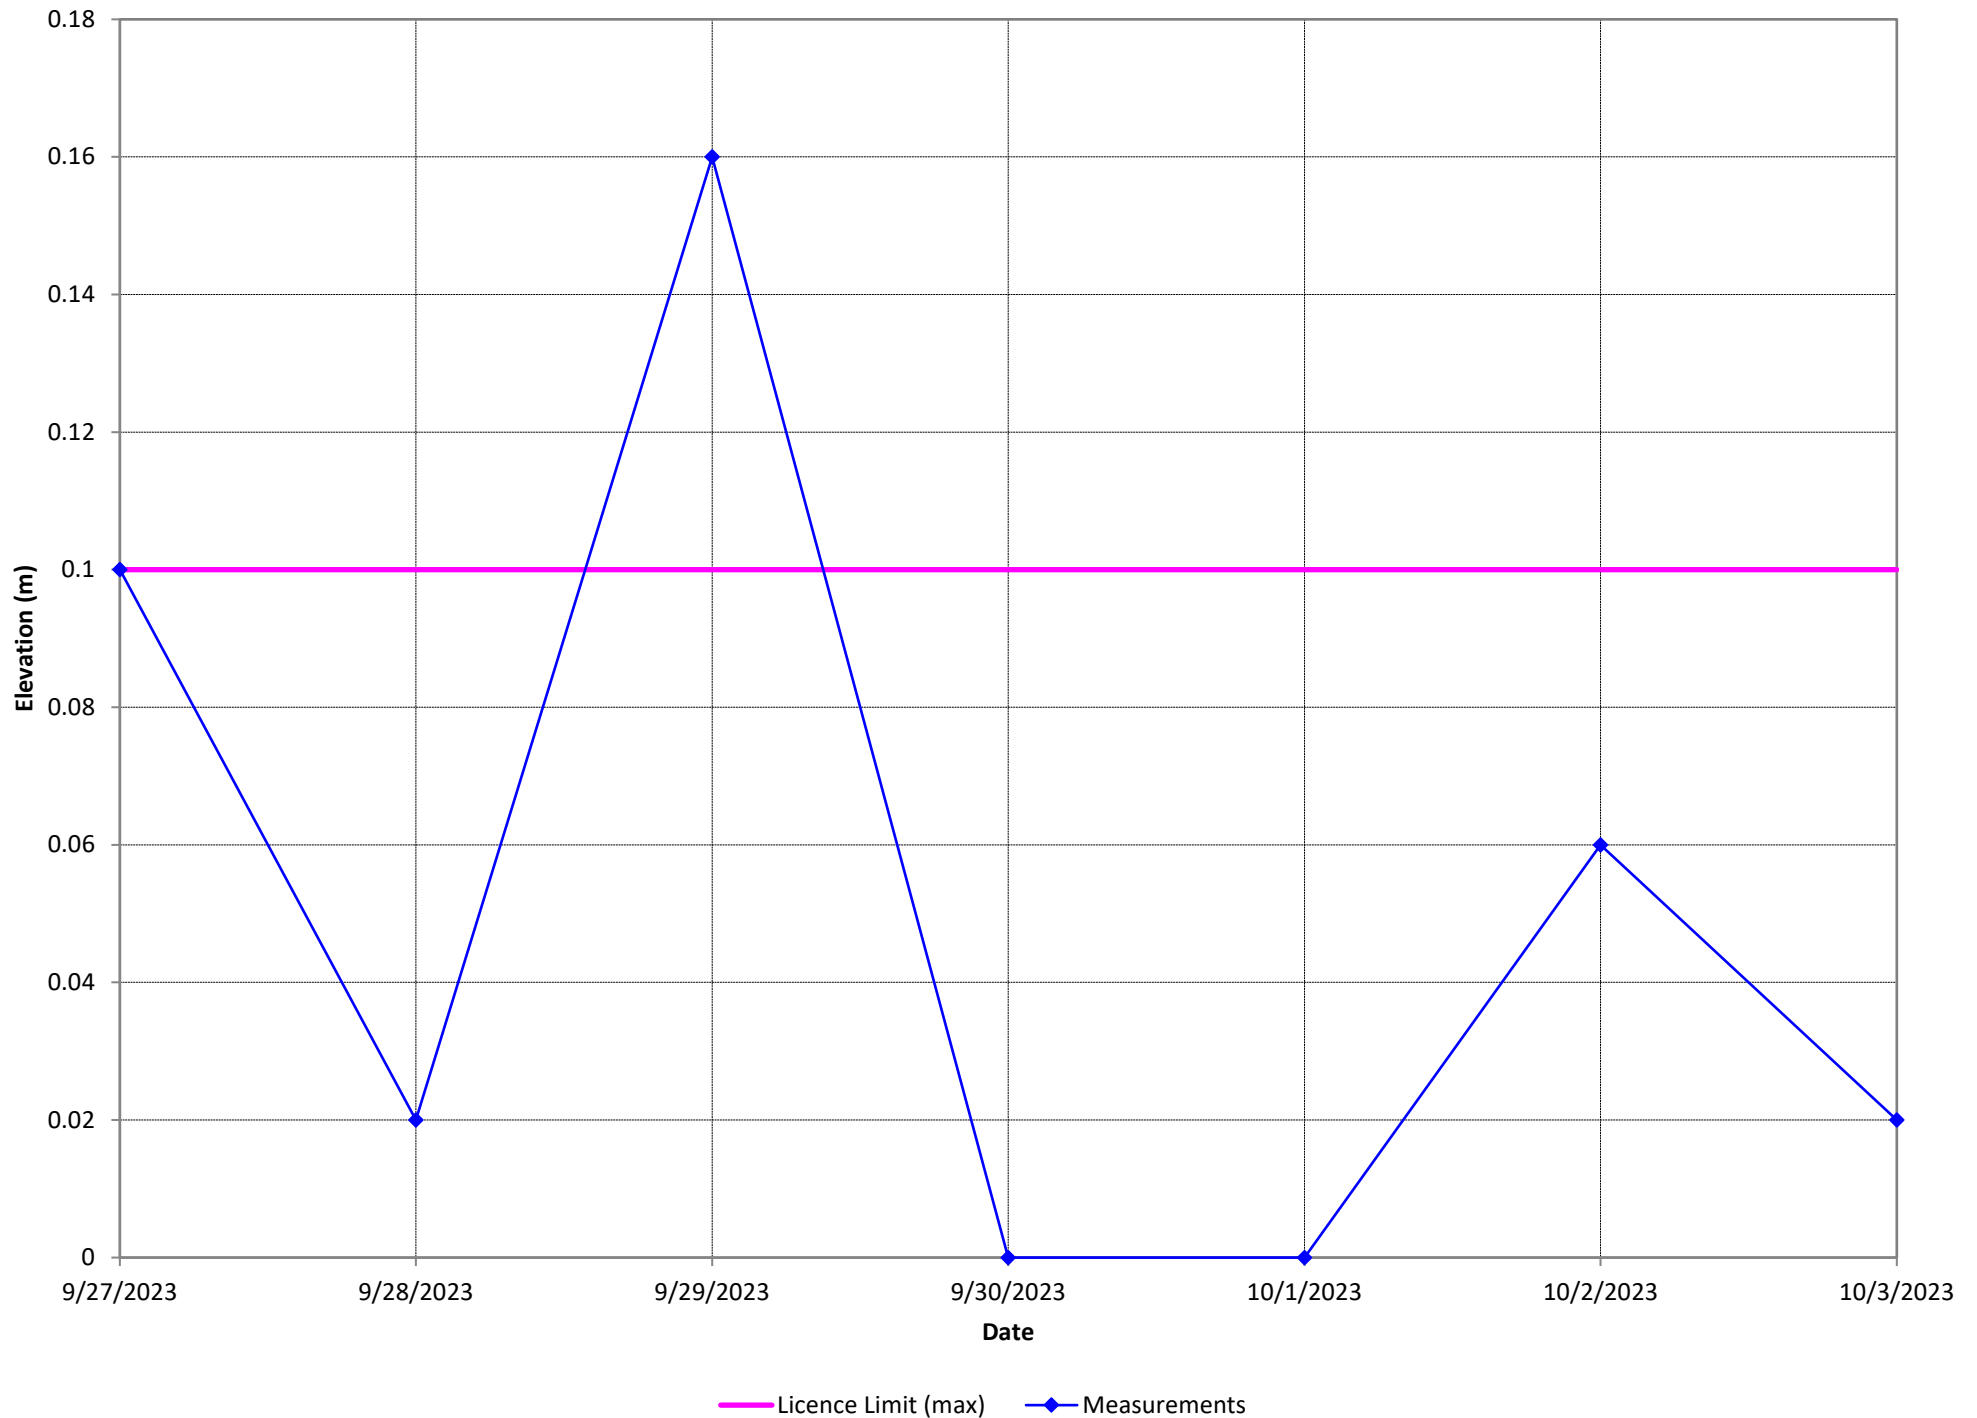

2023 10 18

Ms. Agnes Wittman
Director, Environmental Approvals Branch
Manitoba Environment and Climate
EABDirector@gov.mb.ca

Dear Ms. Wittman:

**WUSKWATIM GENERATING STATION ENVIRONMENT ACT LICENCE – BIRCH
TREE LAKE – MEAN DAILY WATER LEVEL VARIATION ABOVE LICENCE LIMIT**

On September 7, 8, 24 and 29, 2023, the mean daily water level variation on Birch Tree Lake was above the open water licence limit of 0.10 m specified in clause 30 (b) of The Environment Act Licence No. 2699. The Birch Tree Lake daily water level changes on these dates ranged from 0.12 m to 0.16 m. Hydraulic modelling shows that these exceedances were a direct result of the operation of the Wuskwatim Generating Station (G.S.) during a change in the cycling patterns.

In response to decreased flows on the Burntwood River, Wuskwatim Generating Station transitioned from constant discharge operation to unit cycling operation in early September 2023. Despite limiting daily average flow changes to 80 cms, the transition from constant discharge operation to unit cycling operation, and back again, has caused the water levels at Birch Tree Lake to drop and repeatedly produced Birch Tree Lake mean daily water level changes greater than 0.10 m.

Manitoba Hydro is currently testing a new operating procedure at Wuskwatim Generating Station using a rolling, 24-hour average flow change to determine if it may prevent the recurrence of this type of licence exceedance in the future.

If you have any questions about this matter, please call me at (204) 360-3018.

Yours truly,



W.V. Penner, P.Eng
Manager, Waterway Approvals and Monitoring Department

KMP/00184-07311-0100_00.docx

2023 10 26

Ms. Agnes Wittman
Director, Environmental Approvals Branch
Manitoba Environment and Climate
EABDirector@gov.mb.ca

Dear Ms. Wittman:

**WUSKWATIM GENERATING STATION ENVIRONMENT ACT LICENCE – BIRCH
TREE LAKE – MEAN DAILY WATER LEVEL VARIATION ABOVE LICENCE LIMIT**

On October 18, 2023, the mean daily water level variation on Birch Tree Lake was above the licence limit specified in clause 30 (b) of The Environment Act Licence No. 2699.

The Birch Tree Lake daily water level change was 0.13 metres on October 18, 2023 (Figure 1). Clause 30(b) of The Environment Act Licence No. 2699 limits mean daily water level variations on Birch Tree Lake to 0.10 m under open water conditions. Waterway Approvals and Monitoring Department is investigating the incident and we will advise you of the outcome.

If you have any questions about this matter, please call me at (204) 360-3018.


Yours truly,



W.V. Penner, P.Eng
Manager, Waterway Approvals and Monitoring Department

KMP/00184-07311-0101_00.docx
Att.

Birch Tree Lake Daily ROC -- 7 Day Elevation Licence Compliance

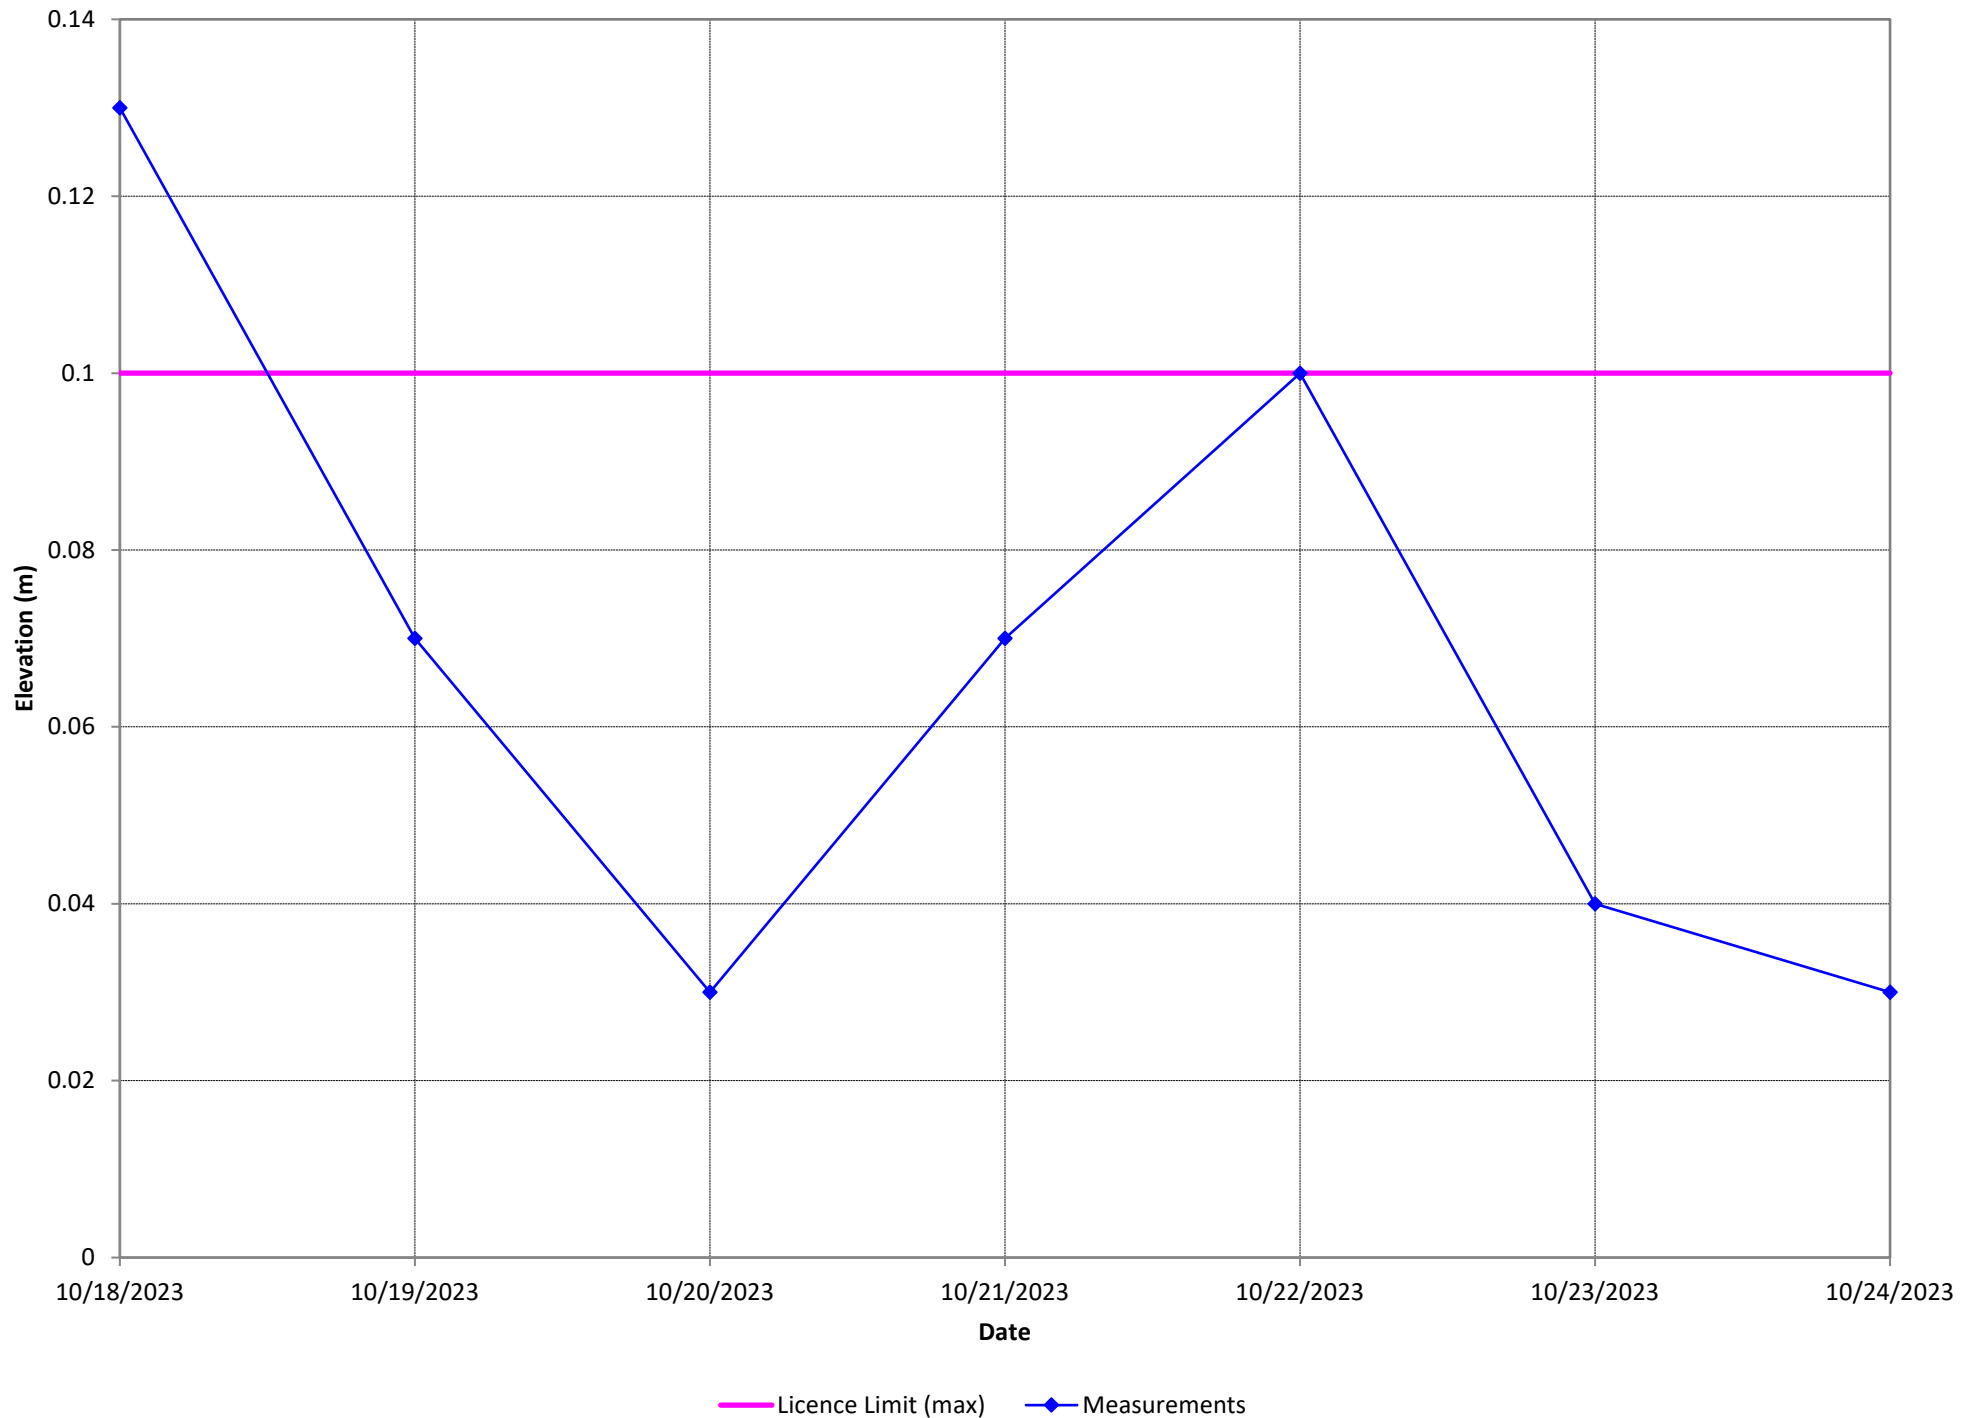

2023 11 09

Ms. Agnes Wittman
Director, Environmental Approvals Branch
Manitoba Environment and Climate
EABDirector@gov.mb.ca

Dear Ms. Wittman:

**WUSKWATIM GENERATING STATION ENVIRONMENT ACT LICENCE – BIRCH
TREE LAKE – MEAN DAILY WATER LEVEL VARIATION ABOVE LICENCE LIMIT**

On October 18, 2023, the mean daily water level variation on Birch Tree Lake was 0.13 m (Figure 1). This is above the open water licence limit of 0.10 m specified in clause 30 (b) of The Environment Act Licence No. 2699. Hydraulic modelling shows that the exceedance was a direct result of the operation of the Wuskwatim Generating Station during a change in the cycling pattern.

Since September 23, 2023, Wuskwatim Generating Station has operated in a unit cycling mode of operation, while limiting average flow changes to 80cms. On October 17, 2023, the unit cycling operation began two hours early and the units were run a little harder, causing the water level at Birch Tree Lake to rise and produce a mean daily water level change greater than 0.10 m on October 18, 2023.

Manitoba Hydro continues to test a new operating procedure at Wuskwatim Generating Station using a rolling, 24-hour average flow change to determine if it may prevent the recurrence of this type of licence exceedance in the future.

If you have any questions about this matter, please call me at (204) 360-3018.


Yours truly,



W.V. Penner, P.Eng
Manager, Waterway Approvals and Monitoring Department

KMP/00184-07311-0102_00.docx
Att.

Birch Tree Lake Daily ROC -- 7 Day Elevation Licence Compliance

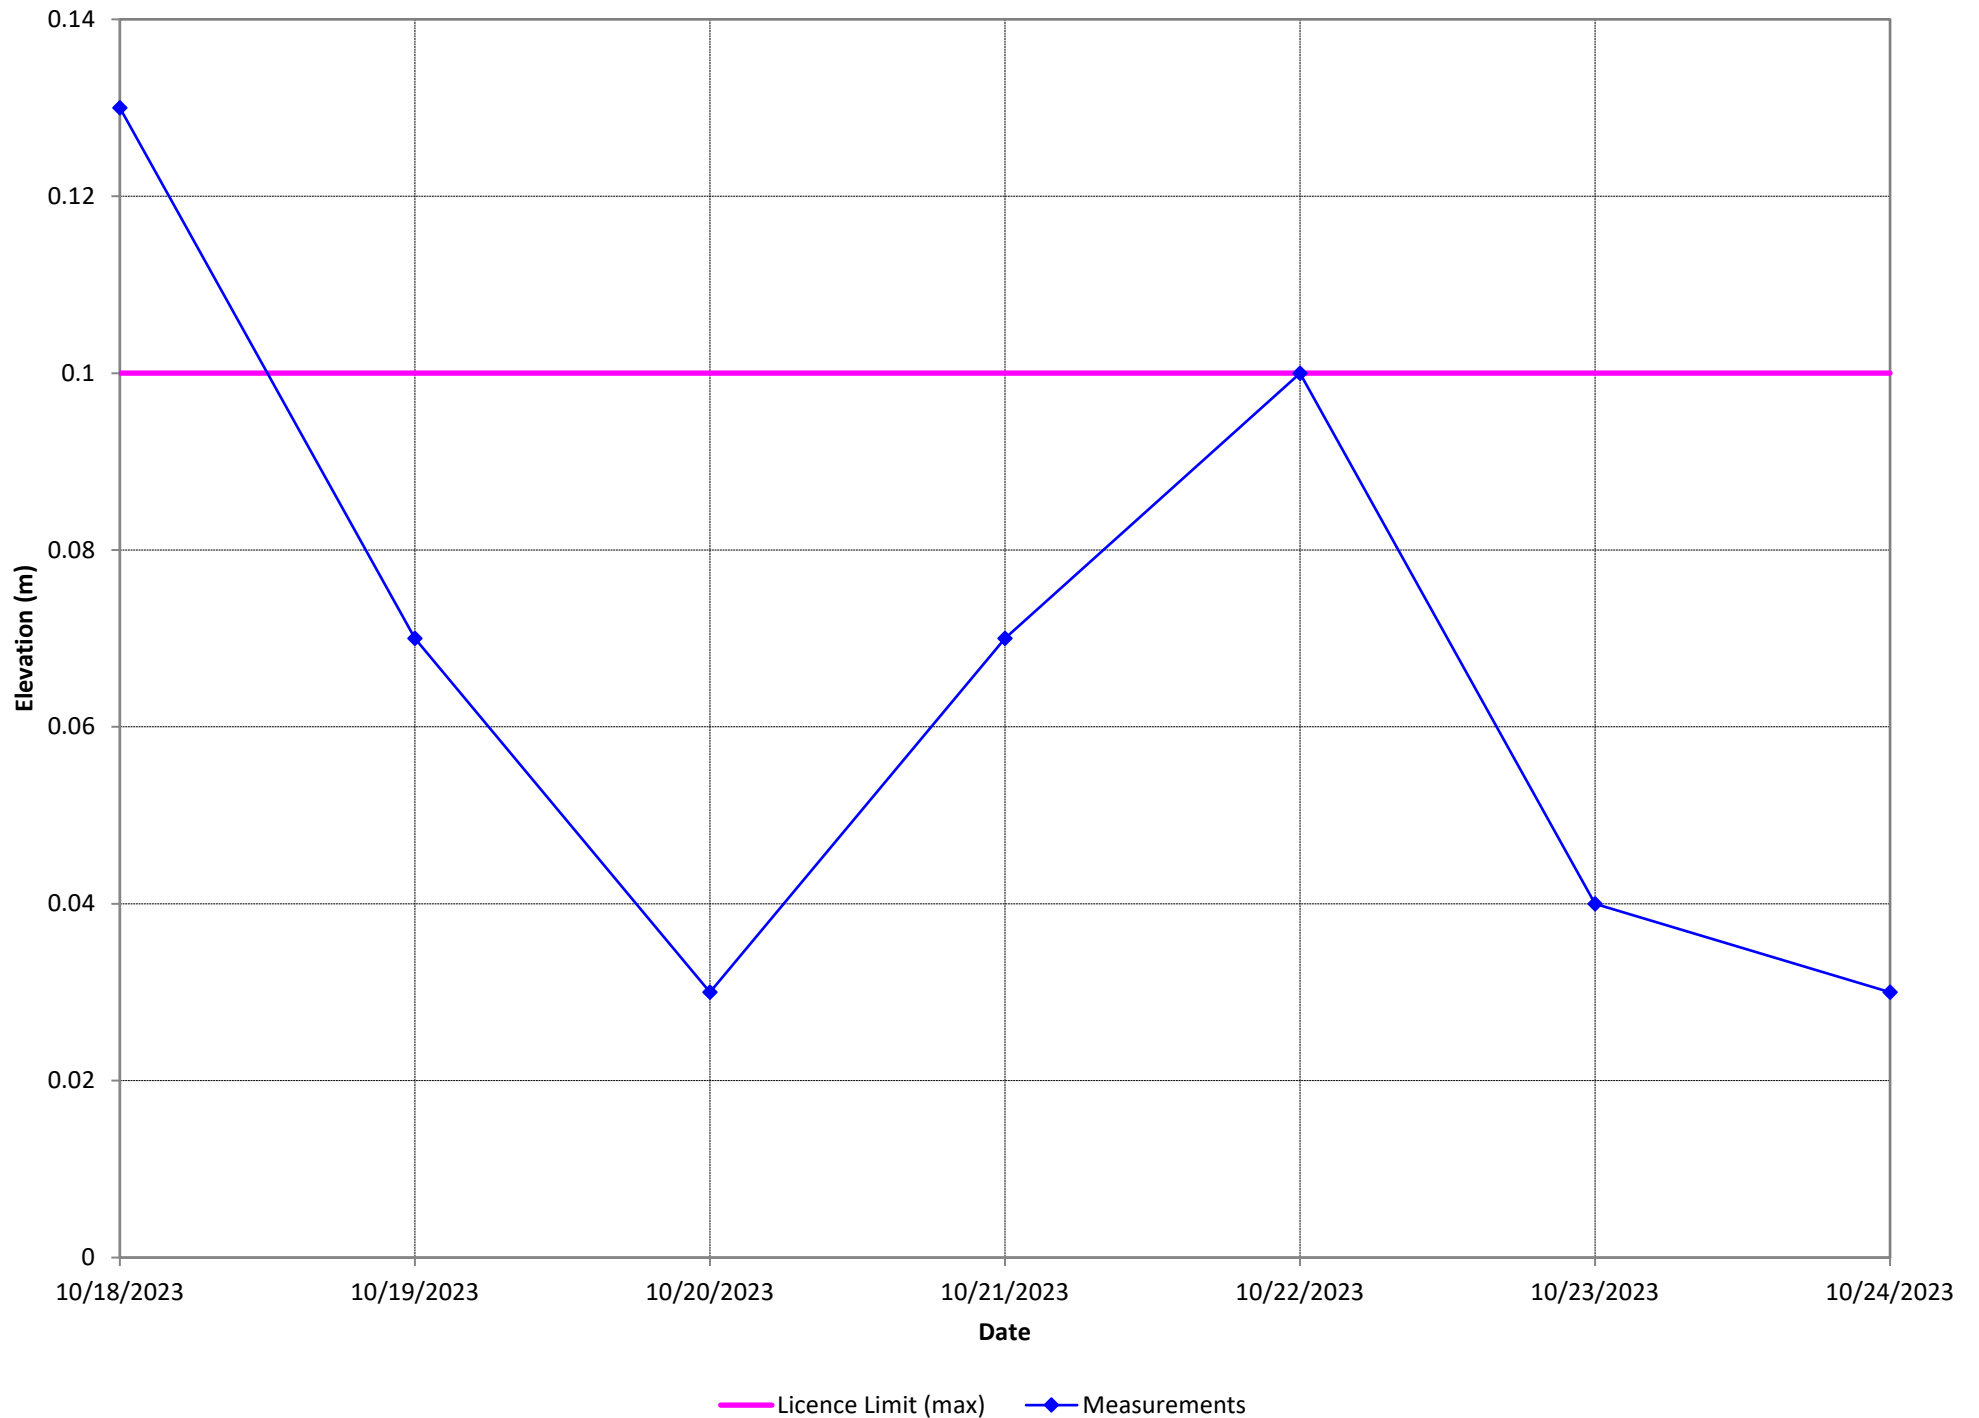

APPENDIX II

2023 WUSKWATIM DAM SAFETY ACTIVITIES LIST

Wuskwatim GS Dam Safety Activities List

	ACTMTIES	Performed By	Tasks Completed	Tasks Planned	Remarks
Inspections	Engineering inspection of embankment dams	Dam Safety	1	1	
	Engineering inspection of concrete dams	Dam Safety	1	1	
	Routine inspection of embankment dams	Site - Utility	12	12	
	Routine inspection of concrete dams	Gen. Sup.	6	6	
	Hydraulic conditions inspection	Dam Safety	1	1	
Analyses	Instrumentation data review (Concrete Dams)	Dam Safety	28	28	
	Instrumentation data review (Embankment Dams)	Dam Safety	11	12	Missing one set of readings from north dike automated piezometers. Issues resolved, and readings returned to database.
Maintenance and Testing	Spillway gate functional testing	Site - Elec/Mech	3	3 (1 per gate)	
	Spillway gate functional full flow test	Site - Elec/Mech	1	1	Spillway gate 3 raised
	Spillway emergency generator - Functional gate lift test	Site - Elec	1	1	Spillway gate 1 raised
	Spillway emergency generator test runs	Site - Operating	12	12	
	Station emergency generator maintenance	Site - Elec	1	1	
	Spillway gate heater maintenance	Site - Elec	3	3 (1 per gate)	
	Spillway gate hoist maintenance	Site - Elec	3	3 (1 per gate)	
	Spillway gate hoist maintenance	Site - Mech	3	3 (1 per gate)	
	Spillway gate inspection	Site - Mech	3	3 (1 per gate)	
	Spillway inspection	Site - Operating	52	52	
	Forebay level monitoring	Site - Operating	12	12	
	Tailrace level monitoring	Site - Operating	12	12	
	Spillway emergency generator maintenance	Mechanical Services	1	1	
Program	Dam Safety EPP - Updates	Dam Safety	1	1	
	Dam Safety Reference Manual - Revision	Dam Safety	-	-	Next Revision 2027
	Delivered DS Training - Routine Inspections	Dam Safety	0	As required	
	DS Training - Emergency Preparedness	Dam Safety	1	As required	1 staff from Wuskwatim completed the ecourse in 2023.